



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

PGT Industries, Inc.
1070 Technology Drive
North Venice, FL 34275

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "HR-5510" PVC Horizontal Rolling Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **MD-HR5510-01** titled "Horizontal Roller - LM", sheets 1 through 18 of 18, dated 05/15/15, with revision A dated 05/05/16, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA# 15-0903.10** and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



Manuel Perez
8/25/16

NOA No. 16-0714.17
Expiration Date: September 24, 2020
Approval Date: September 01, 2016
Page 1


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under previous NOA No.15-0903.10)
2. Drawing No. **MD-HR5510-01** titled "Horizontal Roller - LM", sheets 1 through 18 of 18, dated 05/15/15, with revision A dated 05/05/16, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a PVC sliding glass door, a PVC fixed window and an aluminum sliding glass door, using: Kodispace 4SG TPS spacer system, Duraseal® spacer system, Super Spacer® NXT™ spacer system and XL Edge™ spacer system at insulated glass, prepared by Fenestration Testing Laboratory, Inc., Test Reports No. **FTL-8717**, **FTL-8968** and **FTL-8970**, dated 11/16/15, 06/07/16 and 06/02/16 respectively, all signed and sealed by Idalmis Ortega, P.E.
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
5) Large Missile Impact Test per FBC, TAS 201-94
6) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of series 5410 and series 5510 PVC horizontal sliding windows, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-8072**, dated 02/03/15, signed and sealed by Idalmis Ortega, P.E.
(Submitted under previous NOA No.15-0903.10)
3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
5) Large Missile Impact Test per FBC, TAS 201-94
6) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of series 5510 PVC horizontal sliding windows, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-8073**, dated 02/18/15, signed and sealed by Idalmis Ortega, P.E.
(Submitted under previous NOA No.15-0903.10)

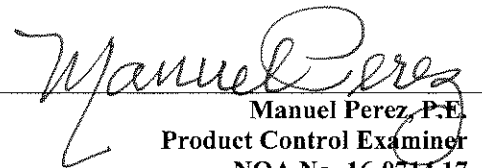
Manuel Perez, P.E.
Product Control Examiner
NOA No. 16-0714.17

Expiration Date: September 24, 2020

Approval Date: September 01, 2016

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

B. TESTS (CONTINUED)

4. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of series 5510 PVC horizontal sliding windows, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-8074**, dated 11/06/14, signed and sealed by Idalmis Ortega, P.E.
(Submitted under previous NOA No.15-0903.10)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC-5th Edition (2014)**, dated 08/28/15, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
(Submitted under previous NOA No.15-0903.10)
2. Glazing complies with **ASTM E1300-09**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **14-0916.10** issued to **Kuraray America, Inc.** for their "**Butacite® PVB Glass Interlayer**" dated 04/25/15, expiring on 12/11/16.
2. Notice of Acceptance No. **14-0916.11** issued to **Kuraray America, Inc.** for their "**SentryGlas® (Clear and White) Glass Interlayers**" dated 06/25/15, expiring on 07/04/18.
3. Notice of Acceptance No. **12-1120.02** issued to Royal Window and Door Profiles, Plant 13 for their "**White Rigid PVC Exterior Extrusions for Windows and Doors**" dated 02/28/13, expiring on 02/28/18.
4. Notice of Acceptance No. **14-0529.13** issued to Royal Window and Door Profiles, Plant 13 for their "**Bronze and Lighter Shades of Cap Coated Rigid PVC Exterior Extrusions for Windows and Doors**" dated 04/16/15, expiring on 04/16/20.
5. Notice of Acceptance No. **14-0529.14** issued to Royal Window and Door Profiles, Plant 13 for their "**Performance Core Rigid PVC Exterior Extrusions for Windows and Doors**" dated 04/16/15, expiring on 04/16/20.


Manuel Perez, P.E.
Product Control Examiner

NOA No. **16-0714.17**

Expiration Date: September 24, 2020

Approval Date: September 01, 2016

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS


1. Statement letter of conformance, complying with **FBC-5th Edition (2014)**, dated August 28, 2015, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
(Submitted under previous NOA No.15-0903.10)
2. Statement letter of no financial interest, dated August 28, 2015, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
(Submitted under previous NOA No.15-0903.10)
3. Proposal issued by Product Control, dated 8/27/14 and revised on 9/10/14, signed by Jaime Gascon, P.E. Supervisor, Product Control Section.
(Submitted under previous NOA No.15-0903.10)
4. Proposal No. **16-0125** issued by the Product Control Section, dated March 09, 2016, signed by Ishaq Chanda, P.E.

E. OTHERS


1. Notice of Acceptance No. **15-0903.10**, issued to PGT Industries, Inc. for their Series "HR-5510" PVC Horizontal Rolling Window - L.M.I., approved on 09/24/15 and expiring on 09/24/20.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 16-0714.17


Expiration Date: September 24, 2020
Approval Date: September 01, 2016

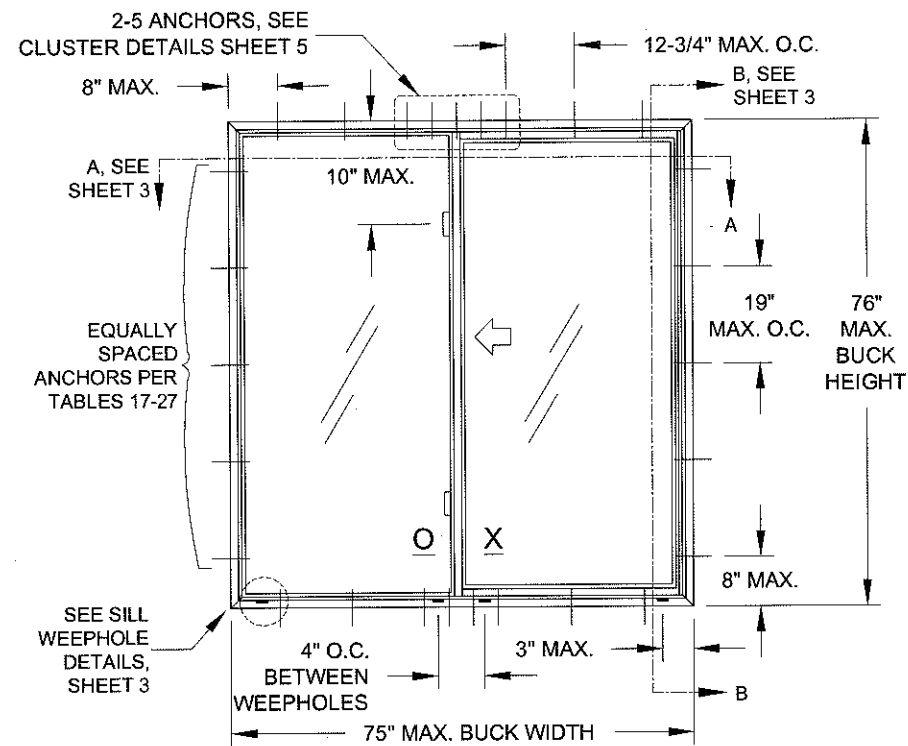

ELEVATION FOR TYP. EQUAL LEG FRAME
SHOWN AS OX CONFIGURATION

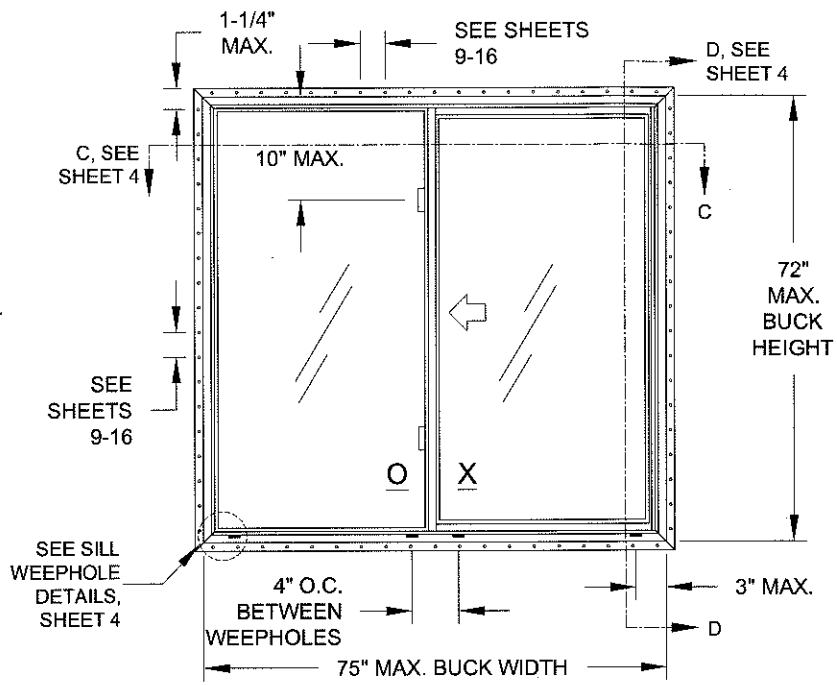

ELEVATION FOR TYP. FIN OR J-CHANNEL
FRAME SHOWN AS OX CONFIGURATION
ANCHORED THROUGH THE NAIL-FIN

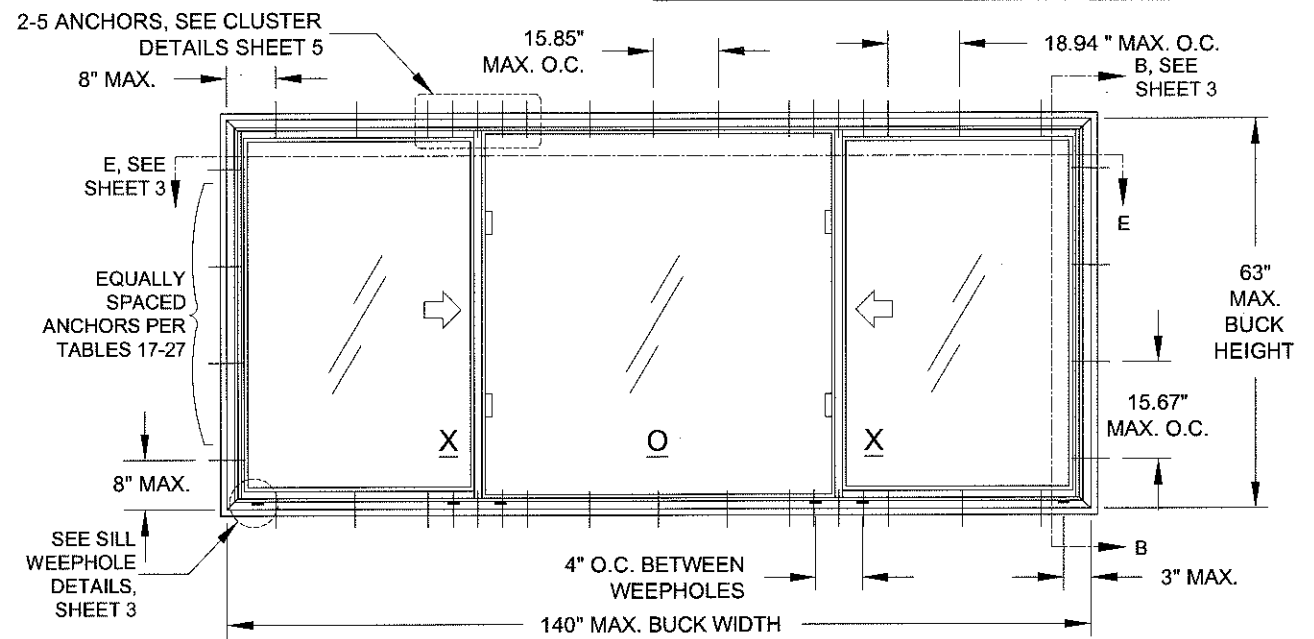

ELEVATION FOR TYP. FLANGE FRAME
SHOWN AS XOX CONFIGURATION

DESIGN PRESSURE RATING	IMPACT RATING
VARIABLES PER REINFORCEMENT LEVEL, SEE SHEETS 6-8	LARGE & SMALL MISSILE IMPACT RESISTANT

GENERAL NOTES: SERIES 5510 IMPACT RESISTANT HORIZONTAL ROLLER

- THIS PRODUCT HAS BEEN DESIGNED & TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE, INCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ).
- SHUTTERS ARE NOT REQUIRED WHEN USED IN WIND-BORNE DEBRIS REGIONS. FOR INSULATED GLASS INSTALLATIONS ABOVE 30' IN THE HVHZ, THE OUTBOARD LITE (CAP) MUST TEMPERED.
- FOR MASONRY APPLICATIONS IN MIAMI-DADE COUNTY, USE ONLY MIAMI-DADE COUNTY APPROVED MASONRY ANCHORS. MATERIALS USED FOR ANCHOR EVALUATIONS WERE SOUTHERN PINE, ASTM C90 CONCRETE MASONRY UNITS AND CONCRETE WITH MIN. KSI PER ANCHOR TYPE.
- ALL WOOD BUCKS LESS THAN 1-1/2" THICK ARE TO BE CONSIDERED 1X INSTALLATIONS. 1X WOOD BUCKS ARE OPTIONAL IF UNIT IS INSTALLED DIRECTLY TO SUBSTRATE. WOOD BUCKS DEPICTED AS 2X ARE 1-1/2" THICK OR GREATER. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND SECURED TO PROPERLY TRANSFER LOADS TO THE STRUCTURE. WOOD BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER, (EOR) OR ARCHITECT OF RECORD, (AOR).
- ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO. USE ANCHORS OF SUFFICIENT LENGTH TO ACHIEVE REQUIRED MIN. EMBEDMENT. INSTALLATION ANCHORS SHOULD BE SEALED. OVERALL SEALING/FLASHING STRATEGY FOR WATER RESISTANCE OF INSTALLATION SHALL BE DONE BY OTHERS AND IS BEYOND THE SCOPE OF THESE INSTRUCTIONS.
- 1/4" MAX. SHIMS ARE REQUIRED AT EACH ANCHOR LOCATION WHERE THE PRODUCT IS NOT FLUSH TO THE SUBSTRATE. USE SHIMS CAPABLE OF TRANSFERRING APPLIED LOADS.
- DESIGN PRESSURES:
 - NEGATIVE DESIGN LOADS BASED ON STRUCTURAL & CYCLE TESTING AND GLASS PER ASTM E1300.
 - POSITIVE DESIGN LOADS BASED ON WATER TEST PRESSURE, STRUCTURAL & CYCLE TESTING AND GLASS PER ASTM E1300.
- THE ANCHORAGE METHODS SHOWN HAVE BEEN DESIGNED TO RESIST THE WINDLOADS CORRESPONDING TO THE REQUIRED DESIGN PRESSURE. THE 33-1/3% STRESS INCREASE HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT. THE 1.6 LOAD DURATION FACTOR WAS USED FOR THE EVALUATION OF ANCHORS INTO WOOD. ANCHORS THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE FOR CORROSION RESISTANCE.
- METAL SUBSTRATE TO MEET MIN. STRENGTH AND THICKNESS REQUIREMENTS PER CURRENT FLORIDA BUILDING CODE AND TO BE REVIEWED BY THE AUTHORITY HAVING JURISDICTION.
- REFERENCES: TEST REPORTS FTL-8072, 8073 & 8074; ELCO ULTRA CON NOA; ELCO CRETE FLEX NOA; ELCO AGGRE-GATOR NOA; ROYAL WINDOW AND DOOR PROFILES, LTD WHITE & BRONZE/LIGHTER SHADES OF CAP COATED PVC EXTRUSION NOA'S; NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION, ANSI/AF&PA NDS & ALUMINUM DESIGN MANUAL
- APPLICABLE EGRESS REQUIREMENTS TO BE REVIEWED BY BUILDING OFFICIAL.

USER INSTRUCTIONS:

- DETERMINE THE SITE SPECIFIC, WINDOW OPENING'S DESIGN PRESSURE REQUIREMENT USING WINDLOAD STANDARD ASCE 7.
- KNOWING YOUR FRAME TYPE, WINDOW CONFIGURATION (OX, XO, XO), SIZE, GLAZING OPTION FROM (TABLE 1) AND REINFORCEMENT LEVEL, DETERMINE YOUR WINDOW'S DESIGN PRESSURE REQUIREMENT FOR THE WINDOW OPENING USING TABLES 6-16 (SHEETS 6-8). IT MUST EQUAL OR EXCEED THE DESIGN PRESSURE REQUIREMENT FOR THE WINDOW OPENING OBTAINED IN STEP 1. USE INDEX TABLE 5 ON SHEET 6 TO HELP FIND THE APPROPRIATE TABLE.
- DETERMINE THE MOST SUITABLE ANCHOR GROUP FROM TABLES 2 AND 3 ON SHEET 2 ACCORDING TO THE INSTALLATION CONDITIONS.
- DETERMINE THE ANCHOR QUANTITY FROM TABLES 17-27 (SHEETS 9-16), VERIFY THE ANCHOR/SUBSTRATE WILL MEET REQUIREMENTS FOR YOUR OPENING'S CONDITION FROM TABLES 2 OR 3, AND THAT ALL MIN. REQUIREMENTS FROM THIS SHEET SET ARE MET.
- INSTALL AS PER SHEET 3 FOR FLANGE/EQUAL LEG INSTALLATION OR SHEET 4 FOR INTEGRAL FIN/J-CHANNEL INSTALLATION. USE TABLE 4 ON SHEET 2 TO FIND THE APPROPRIATE DETAILS.


NOTE: DESIGN PRESSURE RATING DETERMINATION IS THE SAME PROCESS FOR ALL FRAME TYPES (J-CHANNEL, FLANGE, INTEGRAL FIN OR EQUAL LEG/BOX), SEE FIGURE B ON SHEET 2.

STANDARDS USED:

- 2014 FLORIDA BUILDING CODE (FBC), 5TH EDITION
- ASTM E1300-09
- ANSI/AF&PA NDS-2012 FOR WOOD CONSTRUCTION
- ALUMINUM DESIGN MANUAL, ADM-2010
- AISI-S100-07/S2-2010

GENERAL NOTES.....	1
ELEVATIONS.....	1
FRAME, GLASS & ANCHOR OPTIONS.....	2
INSTALLATION, FLANGE & EQUAL LEG/BOX.....	3
INSTALLATION, INTEGRAL FIN & J-CHANNEL.....	4
GLAZING DETAILS.....	5
DESIGN PRESSURES.....	6-8
ANCHOR QUANTITIES.....	9-16
EXTRUSION PROFILES & BOM.....	17
ASSEMBLY.....	18

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 16-0714.17
Expiration Date Sept. 24, 2020
By *Manuel Lopez*
Miami Dade Product Control

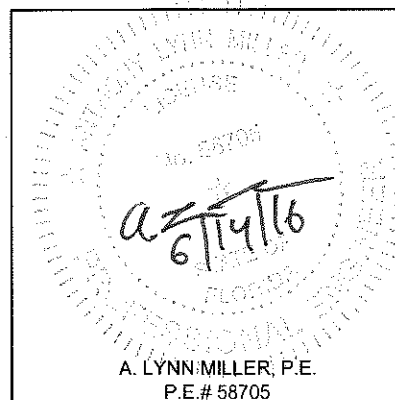

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
P.O. BOX 1529
NOKOMIS, FL 34274

CERT. OF AUTH. #29296

Revised By: JR	Date: 05/05/16	Revision: A) ADDED SPACERS TO SHEET 5.
Revised By:	Date:	Revision:
Description: GENERAL NOTES & ELEVATION		
Title: HORIZONTAL ROLLER - LM		
Series/Model: HR-5510	Scale: NTS	Sheet: 1 OF 18
Drawing No. MD-HR5510-01		Rev: A
Date: 05/15/15		
Drawn By: J ROSOWSKI		

TABLE 1: ALLOWABLE GLASS TYPES

Glass Type	Description (Listed from Exterior to Interior)
5	7/8" Laminated I.G.: 1/8" A Exterior Cap + 7/16" Air Space + 5/16" Laminated; (2) Lites of 1/8" A Glass with .090" PVB Interlayer
6	7/8" Laminated I.G.: 1/8" T Exterior Cap + 7/16" Air Space + 5/16" Laminated; (2) Lites of 1/8" A Glass with .090" PVB Interlayer
7	7/8" Laminated I.G.: 3/16" A Exterior Cap + 3/8" Air Space + 5/16" Laminated; (2) Lites of 1/8" A Glass with .090" PVB Interlayer
8	7/8" Laminated I.G.: 3/16" T Exterior Cap + 3/8" Air Space + 5/16" Laminated; (2) Lites of 1/8" A Glass with .090" PVB Interlayer
10	7/8" Laminated I.G.: 1/8" T Exterior Cap + 7/16" Air Space + 5/16" Laminated; (2) Lites of 1/8" H Glass with .090" SG Interlayer
11	7/8" Laminated I.G.: 3/16" A Exterior Cap + 3/8" Air Space + 5/16" Laminated; (2) Lites of 1/8" H Glass with .090" SG Interlayer
12	7/8" Laminated I.G.: 3/16" T Exterior Cap + 3/8" Air Space + 5/16" Laminated; (2) Lites of 1/8" H Glass with .090" SG Interlayer
14	7/8" Laminated I.G.: 1/8" T Exterior Cap + 5/16" Air Space + 7/16" Laminated; (2) Lites of 3/16" A Glass with .090" SG Interlayer
15	7/8" Laminated I.G.: 3/16" A Exterior Cap + 1/4" Air Space + 7/16" Laminated; (2) Lites of 3/16" A Glass with .090" SG Interlayer
16	7/8" Laminated I.G.: 3/16" T Exterior Cap + 1/4" Air Space + 7/16" Laminated; (2) Lites of 3/16" A Glass with .090" SG Interlayer

SEE SHEET 6, TABLE 5 FOR GLAZING/DESIGN PRESSURE/ANCHORAGE INDEX.

TABLE 2: ALLOWABLE ANCHORS THROUGH THE FRAME

Group	Anchor	Substrate	Min. Edge Distance	Min. Embedment*
A	#10 SMS (steel, 18-8 S.S. or 410 S.S.)	P.T. Southern Pine (SG=0.55)	7/16"	1-3/8"
		Steel, A36*	3/8"	0.050"
		Steel Stud, A653 Gr. 33*	3/8"	0.0451" (18 Ga.)
	3/16" steel Ultracon	Aluminum, 6063-T5*	3/8"	0.050"
		P.T. Southern Pine (SG=0.55)	7/16"	1-3/8"
		Concrete (min. 2.85 ksi)	1"	1-3/8"
B	#12 SMS (steel, 18-8 S.S. or 410 S.S.)	Concrete (min. 2.85 ksi)	1"	1-3/8"
		UngROUTED CMU, (ASTM C-90)	2-1/2"	1-1/4"
		P.T. Southern Pine (SG=0.55)	9/16"	1-3/8"
	3/16" steel Ultracon	Steel, A36*	3/8"	0.050"
		Steel Stud, A653 Gr. 33*	3/8"	0.0451" (18 Ga.)
		Aluminum, 6063-T5*	3/8"	0.063"
C	1/4" steel Ultracon	Concrete (min. 2.85 ksi)	1"	1-3/4"
		UngROUTED CMU, (ASTM C-90)	2-1/2"	1-1/4"
	1/4" steel Creteflex	Concrete (min. 3.35 ksi)	1"	1-3/4"
		P.T. Southern Pine (SG=0.55)	1"	1-3/8"
	1/4" steel Ultracon	Concrete (min. 2.85 ksi)	2-1/2"	1-3/4"
		P.T. Southern Pine (SG=0.55)	1"	1-3/8"
D	1/4" steel Creteflex	Concrete (min. 3.35 ksi)	2-1/2"	1-3/4"
		UngROUTED CMU, (ASTM C-90)	2-1/2"	1-1/4"
	1/4" steel Creteflex	P.T. Southern Pine (SG=0.55)	1"	1-3/8"
		Concrete (min. 3.275 ksi)	1-1/2"	1-3/8"
	1/4" steel Aggre-Gator	P.T. Southern Pine (SG=0.55)	1"	1-3/8"
		Grouted CMU, (ASTM C-90)	2"	2"
	1/4" steel Aggre-Gator	Concrete (min. 3.275 ksi)	1-1/2"	1-3/8"
		P.T. Southern Pine (SG=0.55)	1"	1-3/8"

TABLE 3: ALLOWABLE ANCHORS THROUGH THE INTEGRAL FIN

Group	Anchor	Substrate	Min. Edge Distance	Min. Embedment*
E	2-1/2" x .131" Common Nail	P.T. Southern Pine (SG=0.55)	3/8"	2-7/16"
F	2-1/2" Ring-shank Roofing Nail	P.T. Southern Pine (SG=0.55)	3/8"	2-7/16"
		P.T. Southern Pine (SG=0.55)	1/2"	1-3/8"
	#10 Trusshead SMS (steel, 18-8 S.S. or 410 S.S.)	Aluminum, 6063-T5*	3/8"	0.050"
		Steel Stud, Gr. 33*	3/8"	0.0451" (18 Ga.)
		Steel, A36*	3/8"	0.050"
	#12 SMS (steel, 18-8 S.S. or 410 S.S.)	P.T. Southern Pine (SG=0.55)	9/16"	1-3/8"
		Aluminum, 6063-T5*	3/8"	0.063"
		Steel Stud, Gr. 33*	3/8"	0.050"

* MIN. OF 3
THREADS BEYOND
THE METAL
SUBSTRATE. FOR
STEEL STUDS,
MIN. Fu=45 KSI &
MIN. Fy=33 KSI.

GLASS TYPES 5, 7, 11 & 15
MAY NOT BE USED IN THE
HVHZ ABOVE 30'.

* MIN. OF 3 THREADS
BEYOND THE METAL
SUBSTRATE. FOR
STEEL STUDS,
MIN. Fu=45 KSI &
MIN. Fy=33 KSI.

"UNGROUTED CMU"
VALUES MAY BE
USED FOR GROUTED
CMU APPLICATIONS.

INSTALLATION NOTES, SEE SHEETS 3 & 4 FOR ILLUSTRATIONS:

1) USE ONLY SUBSTRATE-APPROPRIATE ANCHORS LISTED ON
TABLES 2 & 3, THIS SHEET. FOLLOW EMBEDMENT AND EDGE
DISTANCE LIMITS. ANY INSTALLATION OPTION SHOWN MAY BE
USED ON ANY SIDE OF THE WINDOW.

2) MASONRY ANCHORS MAY BE USED INTO WOOD AS PER TABLE
2, THIS SHEET. ALL WOOD BUCKS LESS THAN 1-1/2" THICK ARE TO
BE CONSIDERED 1X INSTALLATIONS. 1X WOOD BUCKS ARE
OPTIONAL IF UNIT IS INSTALLED DIRECTLY TO SUBSTRATE. WOOD
BUCKS DEPICTED AS 2X ARE 1-1/2" THICK OR GREATER. 1X AND 2X
BUCKS (WHEN USED) SHALL BE DESIGNED TO PROPERLY
TRANSFER LOADS TO THE STRUCTURE. WOOD BUCK DESIGN AND
INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR
ARCHITECT OF RECORD.


3) VISIBLE LIGHT WIDTH OR HEIGHT (ALSO REFERRED TO AS
DAYLIGHT OPENING) IS MEASURED FROM BEADING TO BEADING.

4) SEE SHEET 18 FOR OPTIONAL EGRESS LOCK DETAILS.

TABLE 4: INDEX OF INSTALLATION METHODS PER FRAME TYPE

Frame Types (see Fig B)	Glass Options (see Table 1)	Installation Conditions	Substrate Option Detail Sheet
J-Channel (#1)	1 - 4	Through the integral fin.....	into 2X Wood Frame/Buckstrip - sheet 4, option 5
		Through the frame of the window.....	into Metal - sheet 4, option 8
Flange (#2)	1 - 4	Through the frame of the window.....	into 2X Wood Frame/Buckstrip - sheet 4, option 6
		Through the frame of the window.....	into Metal - sheet 4, option 7
Integral Fin (#3)	1 - 4	Through the frame of the window.....	into 2X Wood Frame/Buckstrip - sheet 3, option 1
		Through the frame of the window.....	into Concrete/CMU - sheet 3, option 2
Box / Equal-Leg (#4)	1 - 4	Through the frame of the window.....	through 1X Buckstrip into Concrete/CMU - sheet 3, option 3
		Through the frame of the window.....	into Metal - sheet 3, option 4

FIGURE B: FRAME TYPES

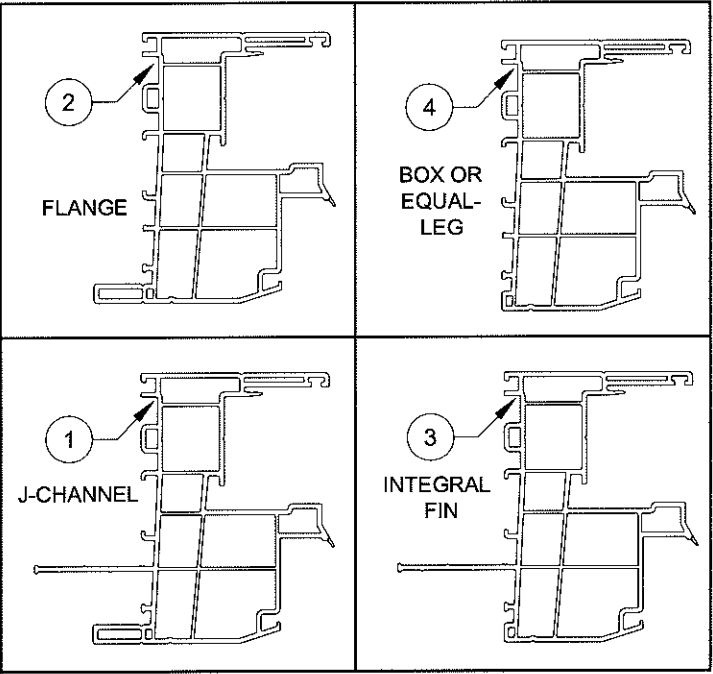

"A" = ANNEALED
"H" = HEAT STRENGTHENED
"T" = TEMPERED
"PVB" = .090" BUTACITE® PVB
BY KURARAY AMERICA, INC.
"SG" = .090" SENTRYGLAS®
INTERLAYER BY KURARAY
AMERICA, INC.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 16-0714-17
Expiration Date Sept 24, 2020
By: *Manuel J. Rosowski*
Miami Dade Product Control

A. LYNN MILLER, P.E.
P.E.# 58705



1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
P.O. BOX 1529
NOKOMIS, FL 34274

CERT. OF AUTH. #29296

Revised By:	Date:	Revision:
Revised By:	Date:	Revision:

Description:
GLASS/ANCHORS/FRAME OPTIONS

Drawn By:
J ROSOWSKI

Title:
HORIZONTAL ROLLER - LM



Date:
05/15/15

Series/Model: HR-5510	Scale: NTS	Sheet: 2 OF 18	Drawing No. MD-HR5510-01	Rev: A
--------------------------	---------------	-------------------	-----------------------------	-----------

INSTALLATION DETAILS FOR FLANGE AND EQUAL-LEG FRAMES

INSTALLATION
OPTION 1

ANCHORED THROUGH
FRAME INTO 2X WOOD
FRAME OR BUCKSTRIP.
SEE NOTE 2, SHEET 2.

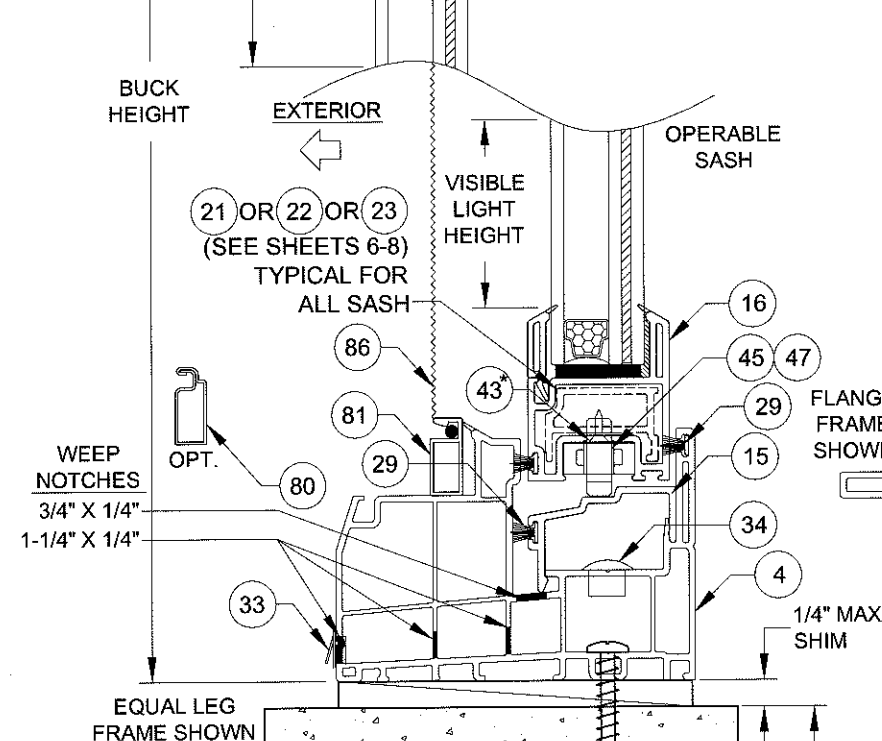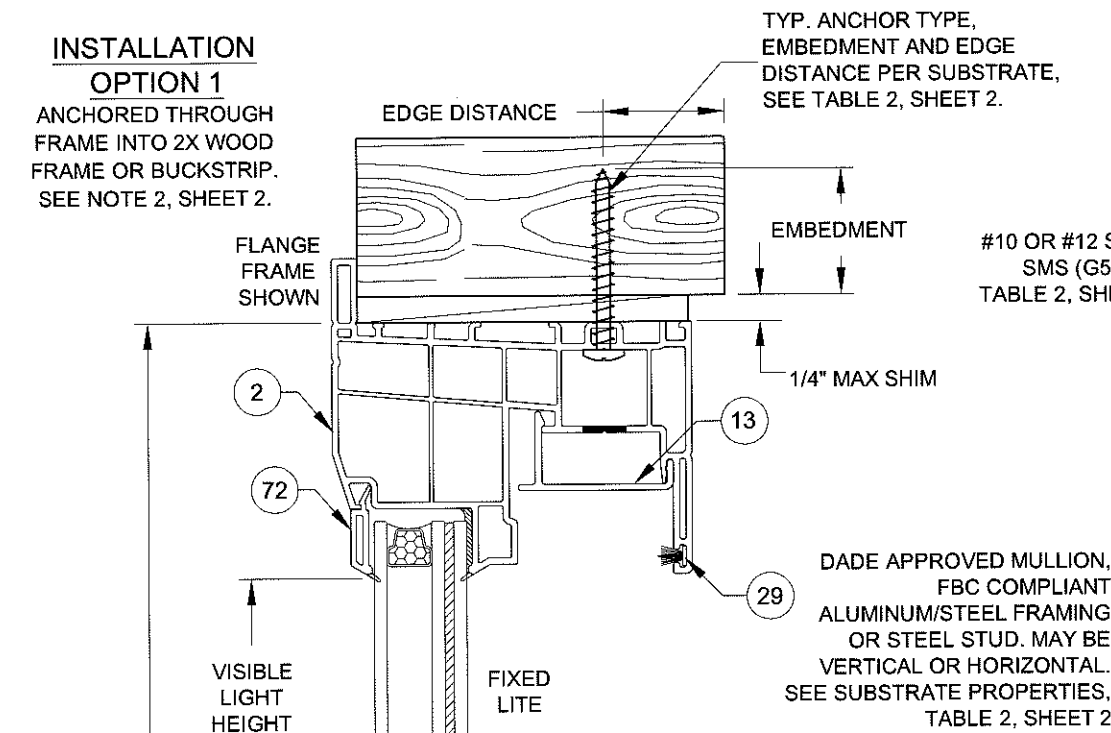

INSTALLATION
OPTION 2



ANCHORED THROUGH
FRAME DIRECTLY INTO
CONCRETE/CMU.

TYP. ANCHOR TYPE,
EMBEDMENT AND EDGE
DISTANCE PER SUBSTRATE,
SEE TABLE 2, SHEET 2.

VERTICAL
SECTION B-B


INSTALLATION
OPTION 4

ANCHORED THROUGH
FRAME INTO METAL

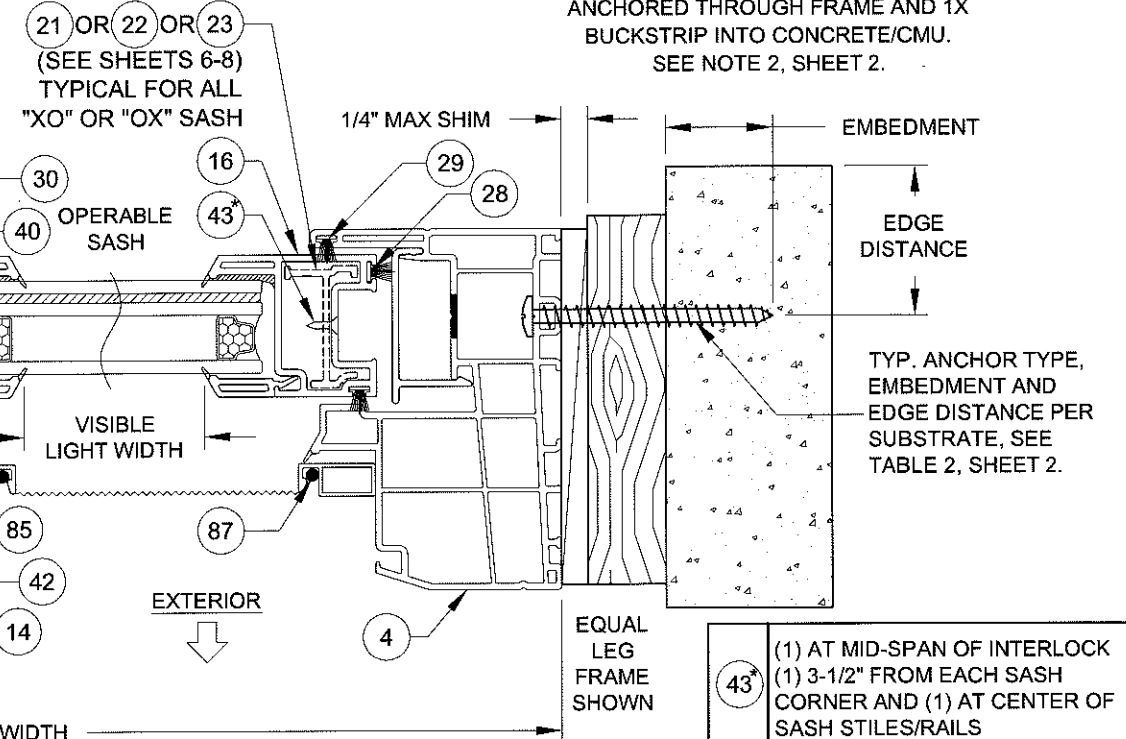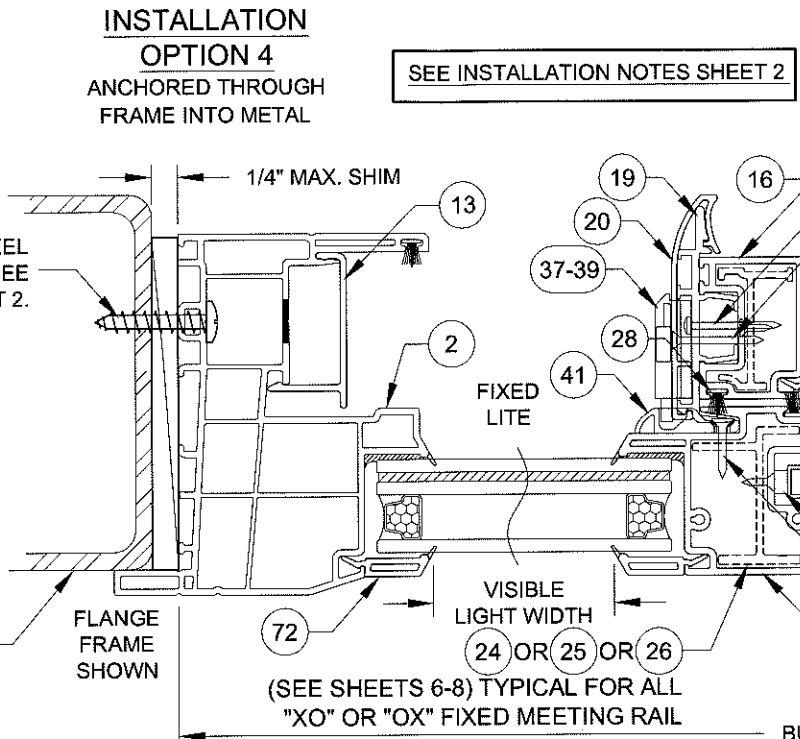

INSTALLATION OPTION 3
ANCHORED THROUGH FRAME AND 1X
BUCKSTRIP INTO CONCRETE/CMU.
SEE NOTE 2, SHEET 2.



HORIZONTAL SECTION A-A (OX)

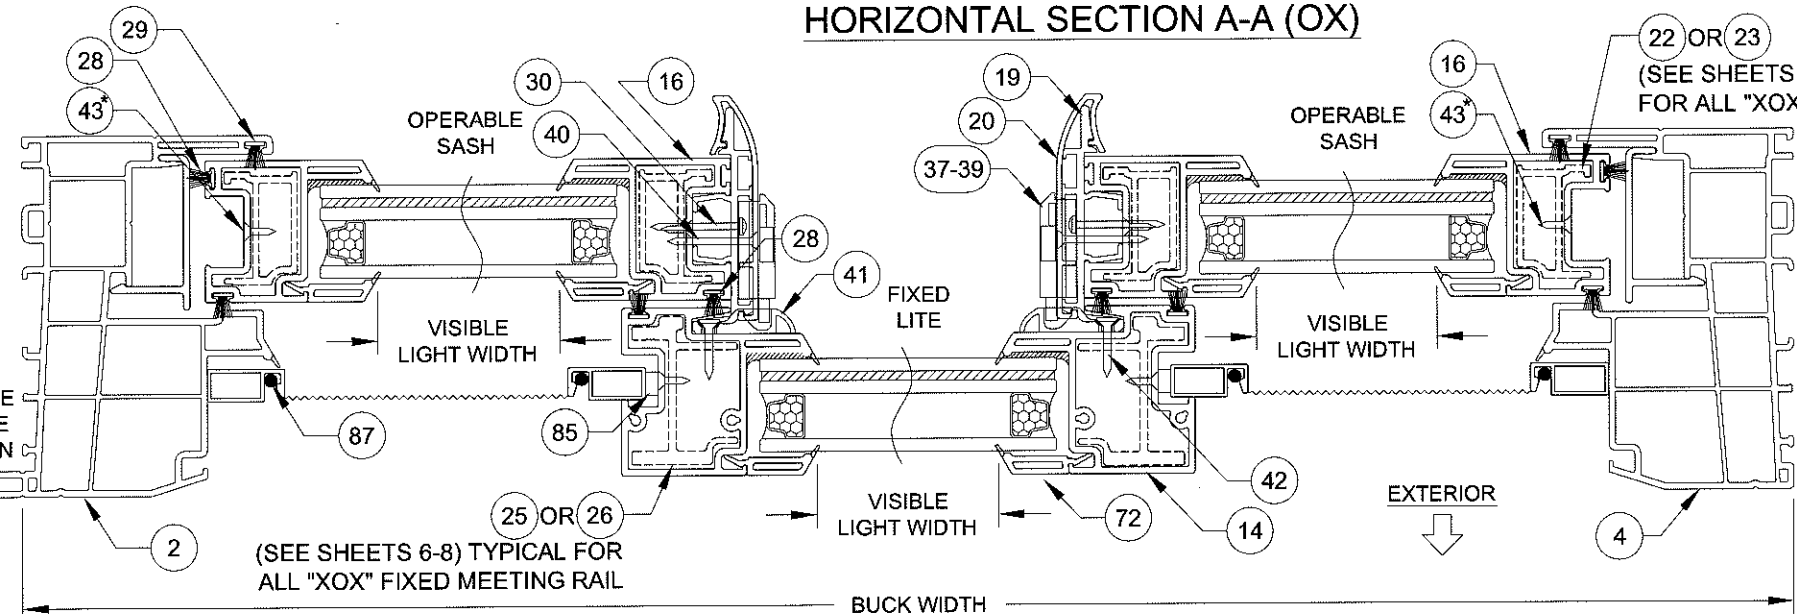

HORIZONTAL SECTION E-E (XOX)

INSTALLATION AS PER SECTION A-A ABOVE

VISIBLE LIGHT FORMULAS
(EQUAL-LITE, XO & OX)
WIDTH: BUCK WIDTH / 2 - 4-1/4"
HEIGHT: BUCK HEIGHT - 7-1/4"

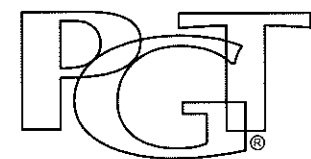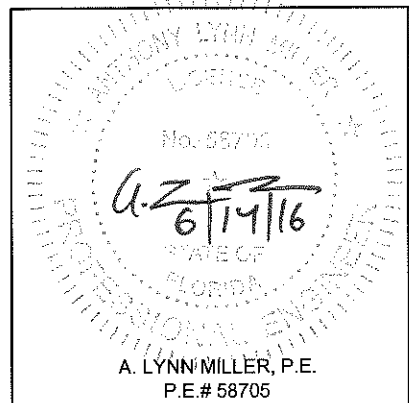

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
P.O. BOX 1529
NOKOMIS, FL 34274

CERT. OF AUTH. #29296

Revised By:	Date:	Revision:	Expiration Date: <u>Sept 24, 2015</u> By <u>Manuel Perez</u> Miami Trade Product Control	
Revised By:	Date:	Revision:		
Description: FLANGE & EQUAL-LEG/BOX FRAMES			Drawn By: J ROSOWSKI	
Title: HORIZONTAL ROLLER - LM			Date: 05/15/15	
Series/Model: HR-5510	Scale: NTS	Sheet: 3 OF 18	Drawing No. MD-HR5510-01	Rev: A




PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 16-0714.17
Expiration Date: Sept. 24, 2020
By: *[Signature]*
Miami Dade Product Council

INSTALLATION DETAILS FOR FIN AND J-CHANNEL FRAMES

INSTALLATION OPTION 5

ANCHORED THROUGH INTEGRAL FIN INTO 2X WOOD FRAME OR BUCK-STRIP. SEE NOTE 2, SHEET 2.

J-CHANNEL FRAME SHOWN

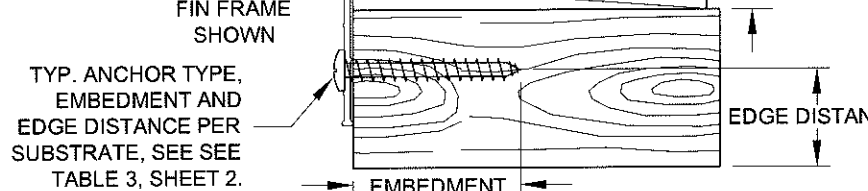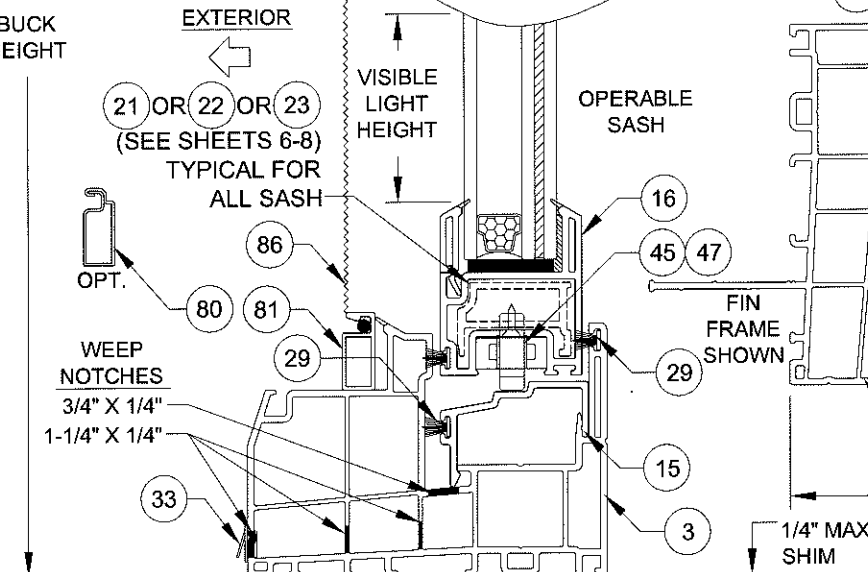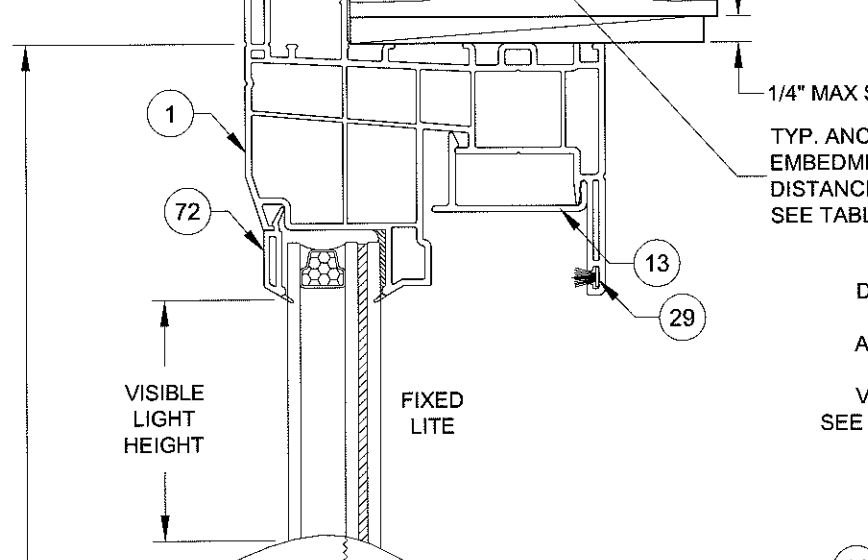

INSTALLATION OPTION 5
ANCHORED THROUGH INTEGRAL FIN INTO 2X WOOD FRAME OR BUCK-STRIP. SEE NOTE 2, SHEET 2.



VERTICAL SECTION D-D

VISIBLE LIGHT FORMULAS
(EQUAL-LITE, XO & OX)
WIDTH: BUCK WIDTH / 2 - 4-1/4"
HEIGHT: BUCK HEIGHT - 7-1/4"


INSTALLATION OPTION 7

ANCHORED THROUGH FRAME INTO METAL (INTEGRAL FIN/FLANGE REMOVED)

SEE INSTALLATION NOTES SHEET 2

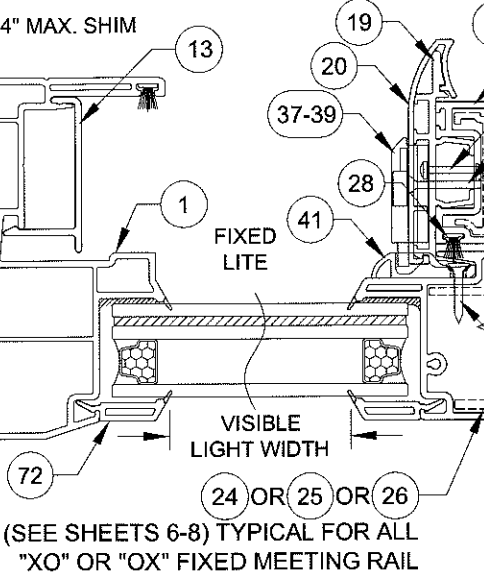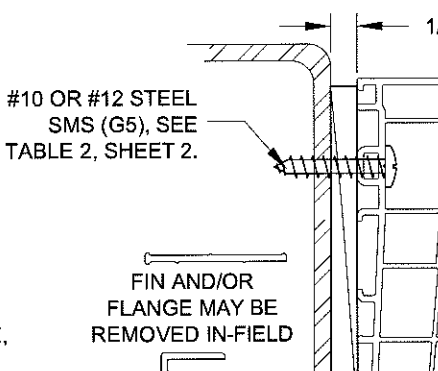


HORIZONTAL SECTION C-C (OX)

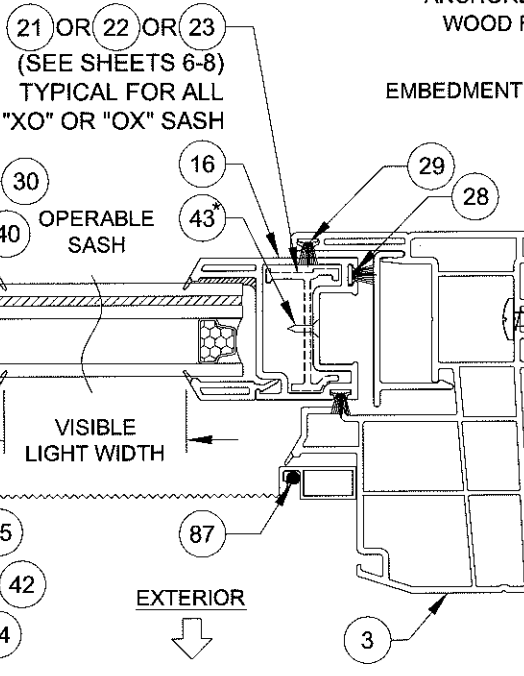

INSTALLATION OPTION 6

ANCHORED THROUGH FRAME INTO 2X WOOD FRAME OR BUCKSTRIP. SEE NOTE 2, SHEET 2.

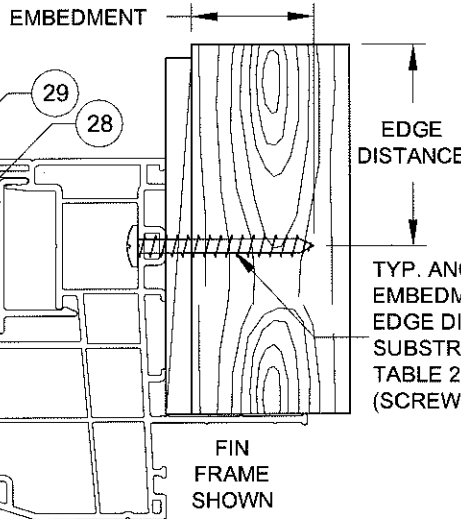

INSTALLATION OPTION 8


ANCHORED THROUGH FIN INTO METAL (FLANGE MAY BE REMOVED)

#10 OR #12 STEEL SMS (G5), SEE TABLE 2, SHEET 2.

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 16-0714.17 Expiration Date 09/24/2020 By Manuel Perez Miami/Dade Product Control

HORIZONTAL SECTION F-F (XOX)

INSTALLATION AS PER SECTION D-D ABOVE


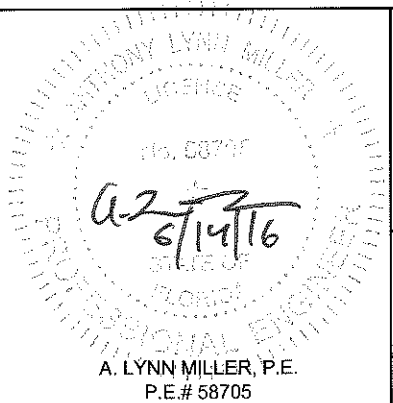


1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
P.O. BOX 1529
NOKOMIS, FL 34274


CERT. OF AUTH. #29296

Revised By:	Date:	Revision:
Revised By:	Date:	Revision:
Description: J-CHANNEL & INTEGRAL FIN FRAMES		
Title: HORIZONTAL ROLLER - LM		
Series/Model: HR-5510		
Scale: NTS		
Sheet: 4 OF 18		
Drawing No. MD-HR5510-01		
Date: 05/15/15		
Rev: A		


Drawn By:
J ROSOWSKI

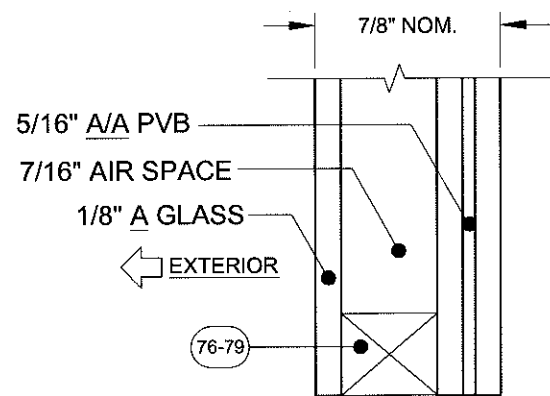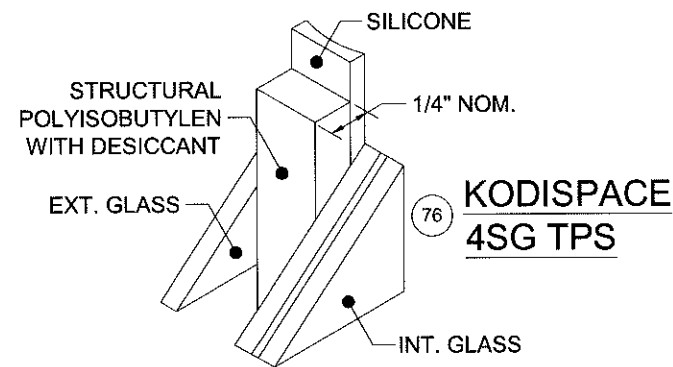


GLASS TYPE 5

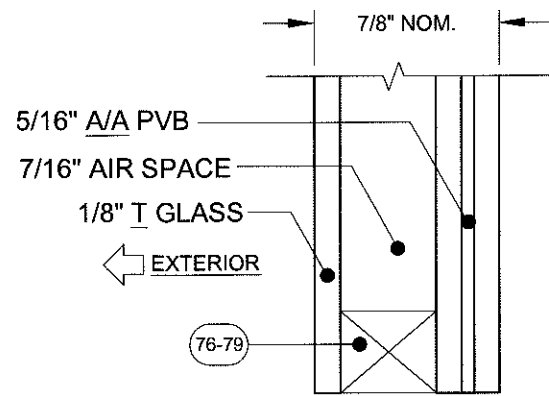



GLASS TYPE 6

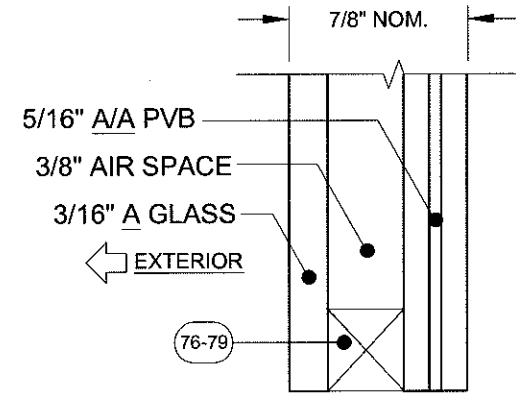


GLASS TYPE 7

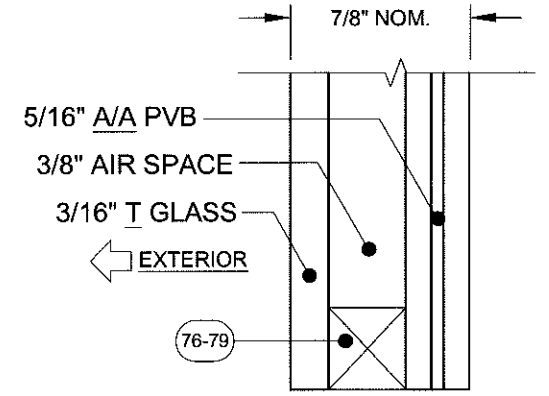


GLASS TYPE 8

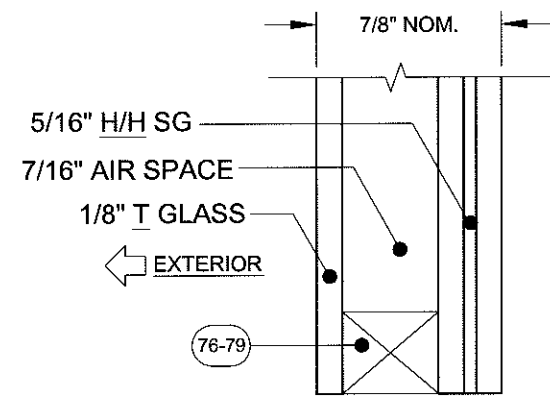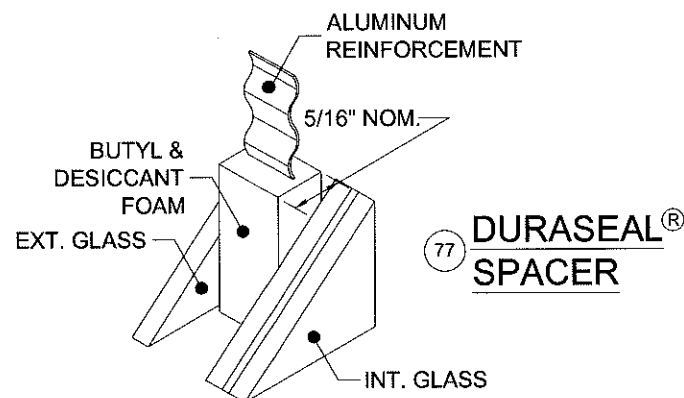


GLASS TYPE 10

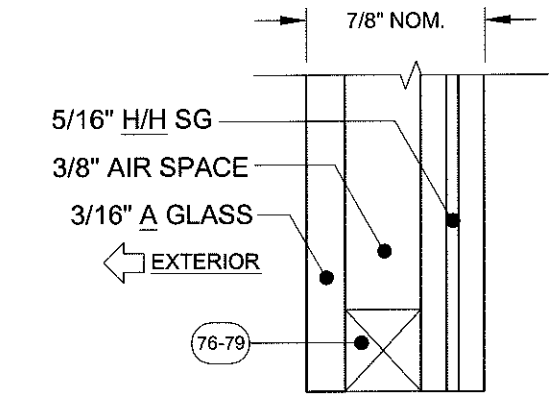




GLASS TYPE 11

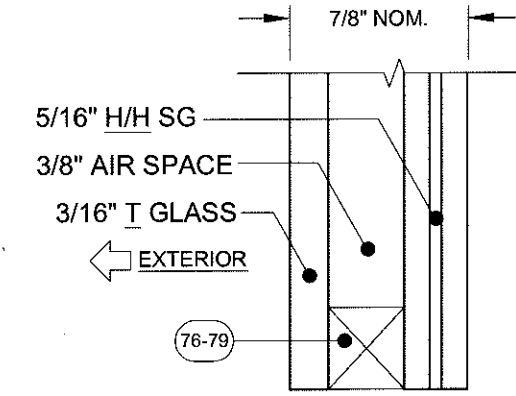


GLASS TYPE 12

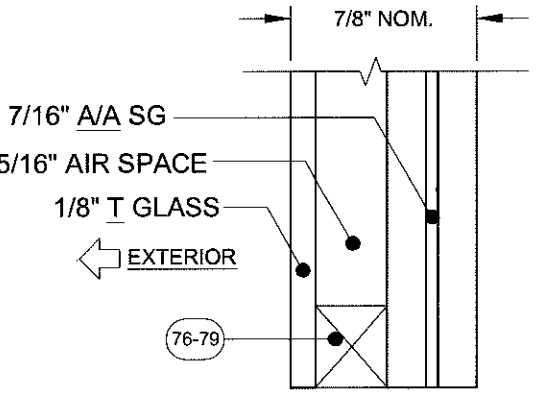


GLASS TYPE 14

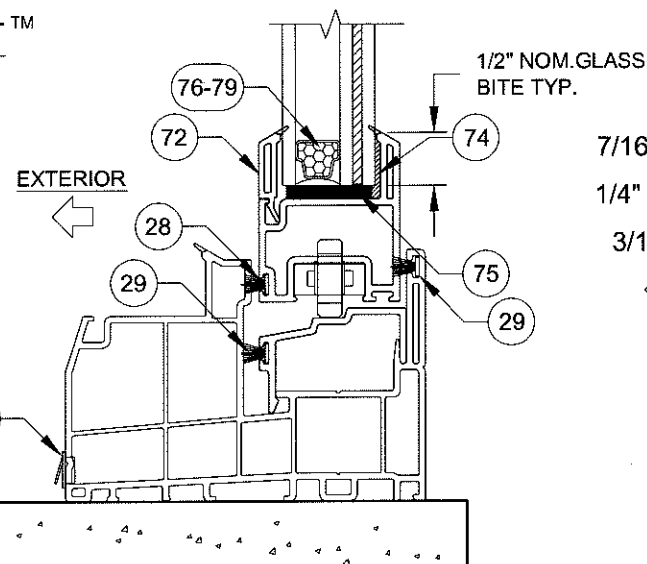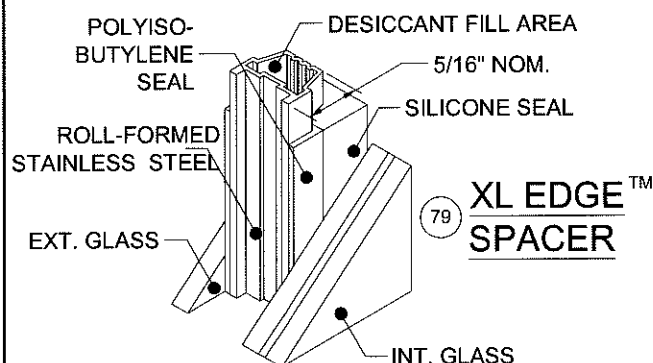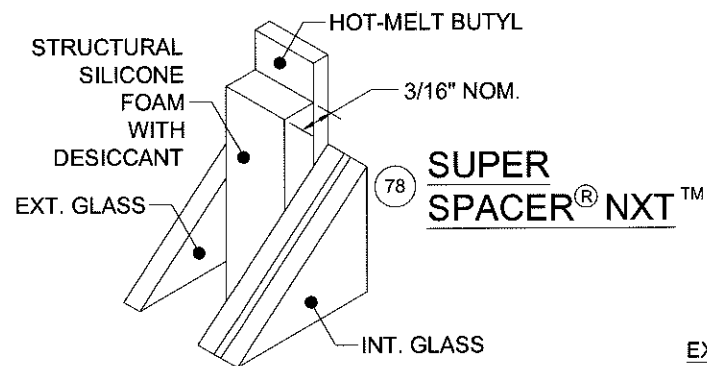

TYP. GLAZING DETAIL

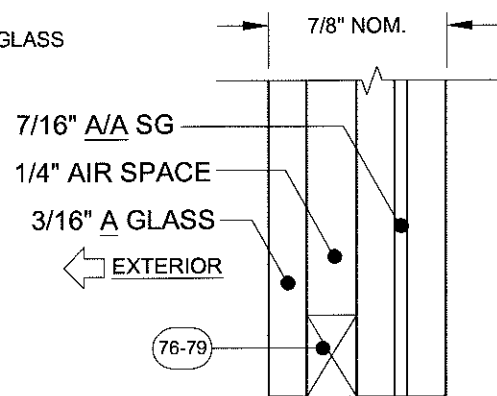

GLASS TYPE 15

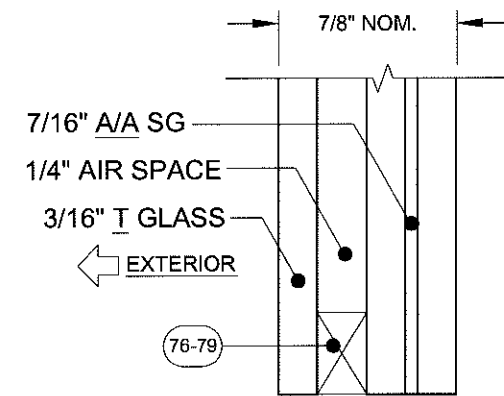

GLASS TYPE 16

**GLASS TYPES 5, 7, 11 & 15
MAY NOT BE USED IN THE
HVHZ ABOVE 30'.**



**GLASS TYPES 10-12 & 14-16
MAY NOT BE USED WITH
J-CHANNEL OR INTEGRAL
FIN FRAMES**

Part #	Description	Material
76	Kommerling 4SG TPS Spacer System	See this Sheet for Materials
77	Quanex Super Spacer nXT with Hot Melt Butyl	
78	Quanex Duraseal Spacer	
79	Cardinal XL Edge Spacer	

REFERENCE TEST REPORTS: FTL-8717, 8968 & 8970

"A" = ANNEALED
"H" = HEAT STRENGTHENED
"T" = TEMPERED
"PVB" = .090" BUTACITE® PVB BY KURARAY AMERICA, INC.
"SG" = .090" SENTRYGLAS® INTERLAYER BY KURARAY AMERICA, INC.

FOR LAMINATED GLAZING COMPONENTS, SEE TABLE 1, SHEET 2.

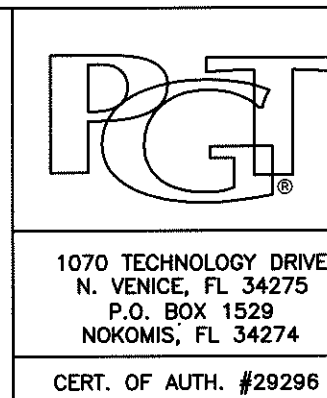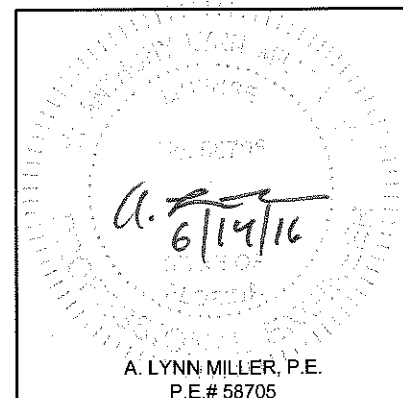


Revised By: JR	Date: 05/05/16	Revision: A) ADDED SPACERS, MOVED CLSTR. DETAILS.
Revised By:	Date:	Revision:
Description: GLAZING DETAILS		
Title: HORIZONTAL ROLLER WINDOW - LM		
Series/Model: HR-5510	Scale: NTS	Sheet: 5 OF 18
Drawing No. MD-HR5510-01		Rev: A
Date: 05/15/15		

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 16-0714.17 Expiration Date Sept. 24, 2020 By: [Signature] Miami Dade Product Control

Drawn By: J ROSOWSKI

TABLE 5:

Index to All Design Pressure and Anchor Quantity Tables								
Config.	Max. Width	Max. Height	Glass Type	Reinf. Level	Design Pressure		Anchor Quantity	
					Table #	Sheet #	Table #	Sheet #
XO or OX	75"	54"	5	1	6	6	17	9
		54"		2	7	6	18	9
		63"		3	8	7	19	10
		72"		4	10	8	20	10
	75"	54"	6 - 8	1	6	6	17	9
		54"		2	7	6	18	9
		63"		3	8	7	19	10
		63"		4	11	8	21	11
		72"		4	10	8	20	10
	75"	76"	10 - 12	4	12	8	22	11
			14 - 16	4	12	8	22	11
XOX	120"	63"	5 - 8	3	9	7	23	12
			5 & 6	4	13	8	24	13
			7 & 8	4	14	8	25	14
	140"	63"	10 - 12	4	15	8	26	15
			14 - 16	4	16	8	27	16

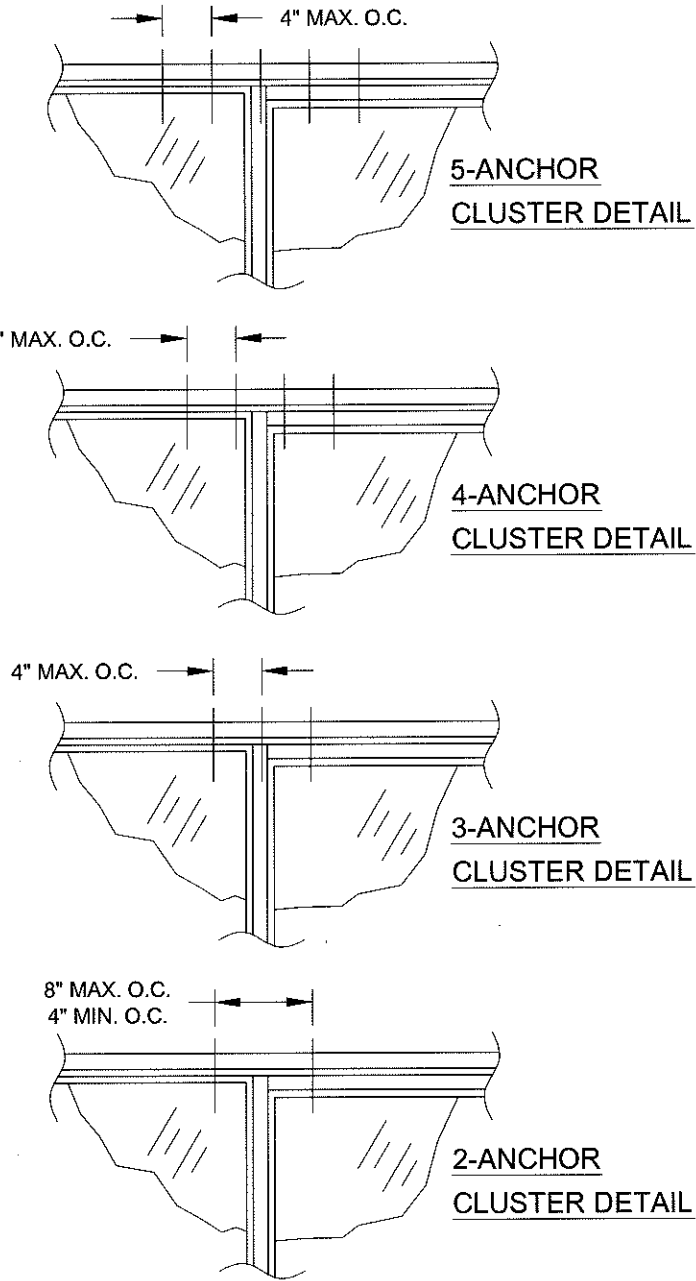

SECTION DETAIL
FOR WINDOWS WITH
LEVEL R1 REINFORCEMENT
(REINFORCEMENTS SHOWN
IN FIGURES APPLY TO ALL
FRAME TYPES &
CONFIGURATIONS)

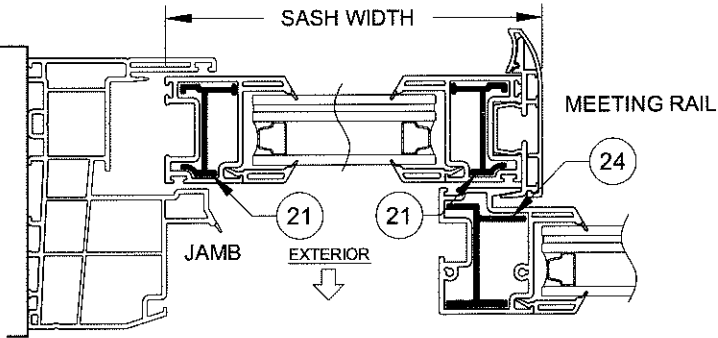
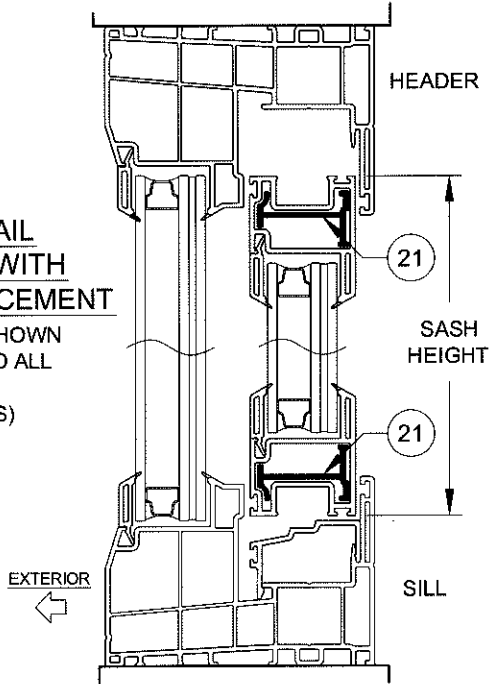


TABLE 6:



Glass Types 5 - 8	Design Pressure (lbs/ft ²) for XO or OX Windows
Reinf. Level R1	All Buck Heights up to 54"
All Buck Widths up to 75"	+50 / -50

SEE TABLE 17 FOR ANCHORAGE


TABLE 7:

Glass Types 5 - 8	Design Pressure (lbs/ft ²) for XO or OX Windows
Reinf. Level R2	All Buck Heights up to 54"
All Buck Widths up to 75"	+65 / -70

SEE TABLE 18 FOR ANCHORAGE

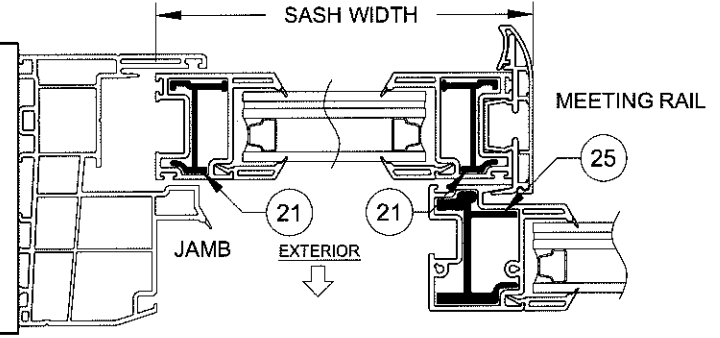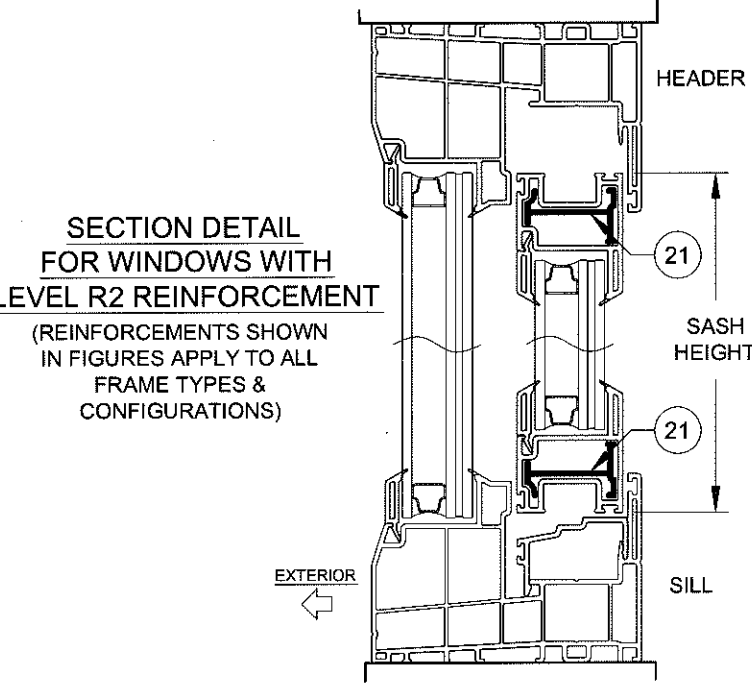

NOTES:
1) USE THESE TABLES FOR ALL WINDOWS
INSTALLED THROUGH THE FRAME OR
INTEGRAL FIN.
2) FRAME DIMENSIONS ARE BUCK WIDTH AND
BUCK HEIGHT (SHEETS 3-4). SASH SIZE IS AS
PER THE FIGURE.
3) FOR SIZES NOT SHOWN, ROUND UP TO THE
NEXT AVAILABLE WIDTH OR HEIGHT
DIMENSION SHOWN ON THE TABLE.
4) "1/4-1/2-1/4" AND "1/3-1/3-1/3" INDICATE THAT
THOSE STANDARD SASH CONFIGURATIONS
FALL WITHIN THE SASH WIDTH RANGE IN THE
ADJACENT COLUMN. "CUSTOM" INDICATES
THAT NO STANDARD SASH CONFIGURATIONS
FALL WITHIN THE RANGE.

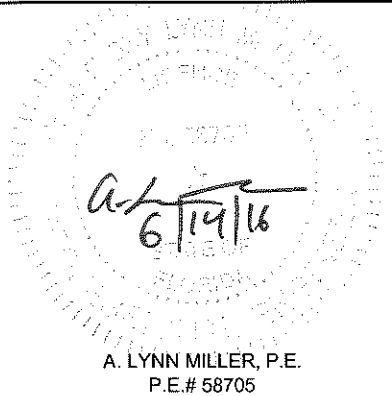

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
P.O. BOX 1529
NOKOMIS, FL 34274

CERT. OF AUTH. #29296

Revised By: JR	Date: 05/05/16	Revision: A) MOVED CLUSTER DETAILS
Revised By:	Date:	Revision:

Description:
DESIGN PRESSURE TABLES


Title:
HORIZONTAL ROLLER - LM

Series/Model: HR-5510	Scale: NTS	Sheet: 6 OF 18	Drawing No. MD-HR5510-01	Rev: A
--------------------------	---------------	-------------------	-----------------------------	-----------

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 16-0714.17
Expiration Date Sept 24, 2020
By *Manuel Perez*
Miami/Dade Product Control

Drawn By:
J ROSOWSKI

Date:
05/15/15

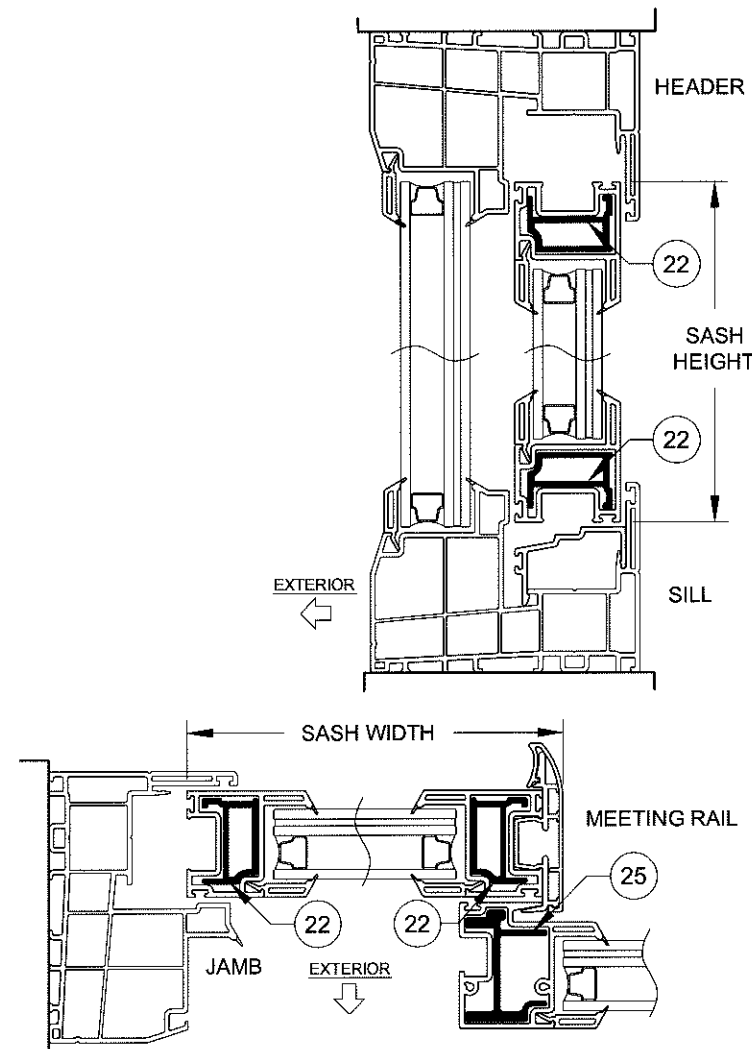

SECTION DETAIL
FOR WINDOWS WITH
LEVEL R3 REINFORCEMENT
(REINFORCEMENTS SHOWN
IN FIGURES APPLY TO ALL
FRAME TYPES &
CONFIGURATIONS)

NOTES:

- 1) USE THESE TABLES FOR ALL WINDOWS INSTALLED THROUGH THE FRAME OR INTEGRAL FIN.
- 2) FRAME DIMENSIONS ARE BUCK WIDTH AND BUCK HEIGHT (SEE SHEETS 3-4). SASH SIZE IS AS PER THE FIGURE.
- 3) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE WIDTH OR HEIGHT DIMENSION SHOWN ON THE TABLE.
- 4) "1/4-1/2-1/4" AND "1/3-1/3-1/3" INDICATE THAT THOSE STANDARD SASH CONFIGURATIONS FALL WITHIN THE SASH WIDTH RANGE IN THE ADJACENT COLUMN. "CUSTOM" INDICATES THAT NO STANDARD SASH CONFIGURATIONS FALL WITHIN THE RANGE.

TABLE 8:

Glass Types 5 - 8	Design Pressure (lbs/ft ²) for XO or OX Windows
Reinf. Level R3	All Buck Heights up to 63"
All Buck Widths up to 75"	+50 / -50

SEE TABLE 19 FOR ANCHORAGE


TABLE 9:

Glass Types 5 - 8	Reinf. Level R3	Sash Configuration	Sash Width Range (in)	Design Pressure (lbs/ft ²) for XO Windows					
				Window Buck Height					
				48"	54"	63"			
Window Buck Width	35-1/4"	1/3-1/3-1/3	11.391 - 11.391	+50.0	-50.0	+50.0	-50.0	+50.0	-50.0
	38"	1/3-1/3-1/3	12.308 - 12.308	+50.0	-50.0	+50.0	-50.0	+50.0	-50.0
	45-1/8"	1/4-1/2-1/4	11.391 - 13.397	+50.0	-50.0	+50.0	-50.0	+50.0	-50.0
		1/3-1/3-1/3	13.398 - 14.683	+50.0	-50.0	+50.0	-50.0	+50.0	-50.0
	47-3/4"	1/4-1/2-1/4	11.391 - 12.297	+50.0	-50.0	+50.0	-50.0	+50.0	-50.0
		1/3-1/3-1/3	12.298 - 15.558	+50.0	-50.0	+50.0	-50.0	+50.0	-50.0
	52-1/8"	Custom	11.391 - 12.016	+50.0	-50.0	+50.0	-50.0	+50.0	-50.0
		1/4-1/2-1/4	12.017 - 13.397	+50.0	-50.0	+50.0	-50.0	+50.0	-50.0
		1/3-1/3-1/3	13.398 - 17.016	+50.0	-50.0	+50.0	-50.0	+50.0	-50.0
	60"	Custom	11.391 - 13.397	+50.0	-50.0	+50.0	-50.0	+50.0	-50.0
		1/4-1/2-1/4	13.398 - 15.360	+50.0	-50.0	+50.0	-50.0	+50.0	-50.0
		1/3-1/3-1/3	15.361 - 19.641	+50.0	-50.0	+50.0	-50.0	+50.0	-50.0
	75"	Custom	11.391 - 13.397	+50.0	-50.0	+50.0	-50.0	+50.0	-50.0
		1/4-1/2-1/4	13.398 - 19.110	+50.0	-50.0	+50.0	-50.0	+50.0	-50.0
		1/3-1/3-1/3	19.111 - 24.641	+50.0	-50.0	+50.0	-50.0	+50.0	-50.0
	96"	Custom	18.360 - 19.397	+50.0	-50.0	+50.0	-50.0	+49.1*	-49.1*
		1/4-1/2-1/4	19.398 - 24.360	+50.0	-50.0	+50.0	-50.0	+50.0	-50.0
		Custom	24.361 - 30.360	+50.0	-50.0	+50.0	-50.0	+50.0	-50.0
	120"	1/4-1/2-1/4	** - 30.360	+50.0	-50.0	+50.0	-50.0	+49.1*	-49.1*

* +50/-50 FOR GLASS TYPES 6-8

SEE TABLE 23 FOR ANCHORAGE

** MIN. SASH SIZE = $\frac{\text{WINDOW WIDTH} - 59.28}{2}$

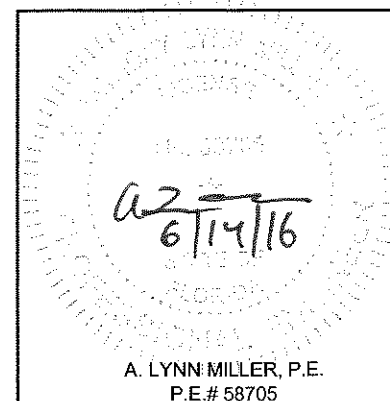

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
P.O. BOX 1529
NOKOMIS, FL 34274

CERT. OF AUTH. #29296

Revised By:	Date:	Revision:	Acceptance No. 10-054-0000 Expiration Date Sept 24, 2020 By Manuel Lopez Miami Dade Product Control		
Revised By:	Date:	Revision:			
Description: DESIGN PRESSURE TABLES			Drawn By: J ROSOWSKI		
Title: HORIZONTAL ROLLER - LM			Date: 05/15/15		
Series/Model: HR-5510	Scale: NTS	Sheet: 7 OF 18	Drawing No. MD-HR5510-01		Rev: A

TABLE 10: Design Pressure (lbs/ft²) for XO or OX Windows. Glass Types 6-8, Reinf. Level R4, All Buck Widths up to 75".

SEE TABLE 20 FOR ANCHORAGE

TABLE 11: Design Pressure (lbs/ft²) for XO or OX Windows. Glass Types 5-8, Reinf. Level R4, Window Buck Height 48", 54", 63".

* +65/-70 FOR GLASS TYPES 6-8
SEE TABLE 21 FOR ANCHORAGE

TABLE 12: Design Pressure (lbs/ft²) for XO or OX Windows. Glass Types 10-12 & 14-16, Reinf. Level R4, Window Buck Height 54", 63", 76".

SEE TABLE 22 FOR ANCHORAGE

TABLE 13: Design Pressure (lbs/ft²) for XO or OX Windows. Glass Types 5 & 6, Reinf. Level R4, Sash Configuration, Sash Width Range (in), Window Buck Height 36", 48", 54", 63".

** MIN. SASH SIZE = WINDOW WIDTH - 59.28 / 2
SEE TABLE 24 FOR ANCHORAGE

TABLE 15: Design Pressure (lbs/ft²) for XO or OX Windows. Glass Types 10-12, Reinf. Level R4, Sash Configuration, Sash Width Range (in), Window Buck Height 48", 54", 63".

* +65/-110 FOR GLASS TYPES 11 & 12

SEE TABLE 26 FOR ANCHORAGE

** MIN. SASH SIZE = WINDOW WIDTH - 60.72 / 2

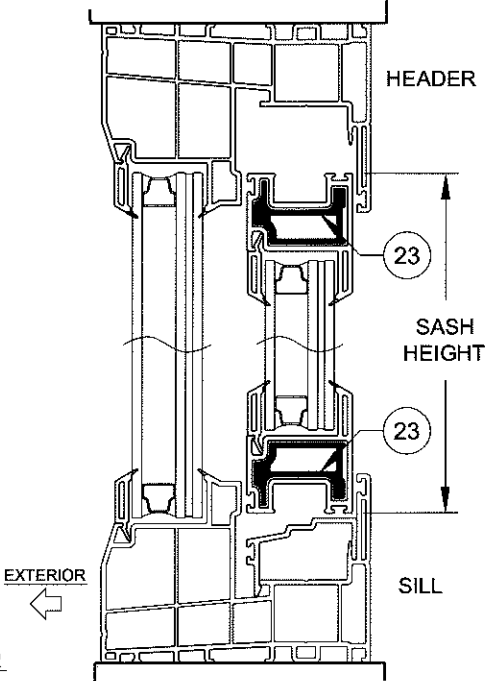


TABLE 14: Design Pressure (lbs/ft²) for XO or OX Windows. Glass Types 7 & 8, Reinf. Level R4, Sash Configuration, Sash Width Range (in), Window Buck Height 36", 48", 54", 63".


* +65/-70 FOR GLASS TYPE 8

SEE TABLE 25 FOR ANCHORAGE

** MIN. SASH SIZE = WINDOW WIDTH - 59.28 / 2

TABLE 16: Design Pressure (lbs/ft²) for XO or OX Windows. Glass Types 14-16, Reinf. Level R4, Sash Configuration, Sash Width Range (in), Window Buck Height 48", 54", 63".

SEE TABLE 27 FOR ANCHORAGE

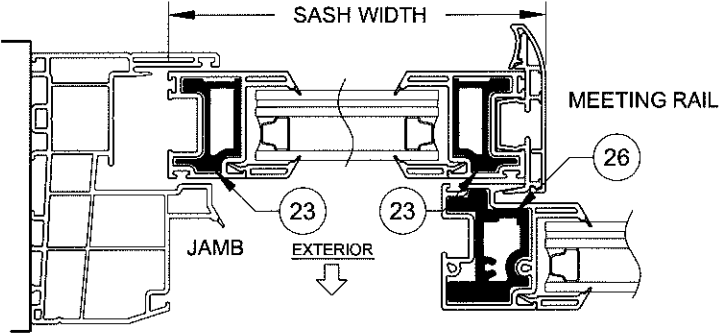

SECTION DETAIL FOR WINDOWS WITH LEVEL R4 REINFORCEMENT (REINFORCEMENTS SHOWN IN FIGURES APPLY TO ALL FRAME TYPES & CONFIGURATIONS)

GLASS TYPES 10-12 & 14-16 MAY NOT BE USED WITH J-CHANNEL OR INTEGRAL FIN FRAMES

NOTES: 1) USE THESE TABLES FOR ALL WINDOWS INSTALLED THROUGH THE FRAME OR INTEGRAL FIN AS ALLOWED BY GLASS TYPE. 2) FRAME DIMENSIONS ARE BUCK WIDTH AND BUCK HEIGHT (SEE SHEETS 3-4). SASH SIZE IS AS PER THE FIGURE. 3) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE WIDTH OR HEIGHT DIMENSION SHOWN ON THE TABLE. 4) "1/4-1/2-1/4" AND "1/3-1/3-1/3" INDICATE THAT THOSE STANDARD SASH CONFIGURATIONS FALL WITHIN THE SASH WIDTH RANGE IN THE ADJACENT COLUMN. "CUSTOM" INDICATES THAT NO STANDARD SASH CONFIGURATIONS FALL WITHIN THE RANGE.

A. LYNN MILLER, P.E. P.E.# 58705



1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 P.O. BOX 1529 NOKOMIS, FL 34274

CERT. OF AUTH. #29296

Table with 3 columns: Revised By, Date, Revision.

Description: DESIGN PRESSURE TABLES

Title: HORIZONTAL ROLLER - LM

Series/Model: HR-5510 Scale: NTS Sheet: 8 OF 18

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 16-0714-17 Expiration Date Sept. 24, 2020

Drawn By: J ROSOWSKI

Date: 05/15/15

Drawing No. MD-HR5510-01 Rev: A

TABLE 17:

Glass Types 5 - 8		Sash Width (in)	Anchor Quantities for XO or OX Windows															
			30" Height				36" Height				48" Height				54" Height			
			Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb
Reinf. Level R1																		
Window Buck Width	25-1/2"	12.147	Anchor Group A								Anchor Group C							
	28"	13.397	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3
	36"	17.397	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3
	42"	20.397	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3
	48"	23.397	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3
	60"	29.397	2+C2+2	2	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	2	2+C2+2	3	2+C2+2	3	2+C2+2	3
	75"	36.897	2+C2+2	2	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	2	2+C2+2	3	2+C2+2	3	2+C2+2	3
Window Buck Width	25-1/2"	12.147	Anchor Group B								Anchor Group D							
	28"	13.397	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3
	36"	17.397	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3
	42"	20.397	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3
	48"	23.397	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3
	60"	29.397	2+C2+2	2	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	2	2+C2+2	3	2+C2+2	3	2+C2+2	3
	75"	36.897	2+C2+2	2	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	2	2+C2+2	3	2+C2+2	3	2+C2+2	3

SEE TABLE 6 FOR DESIGN PRESSURE

TABLE 18:



Glass Types 5 - 8			Sash Width (in)	Anchor Quantities for XO or OX Windows																															
				30" Height				36" Height				48" Height				54" Height				30" Height				36" Height				48" Height				54" Height			
				Head & Sill		Jamb	Head & Sill		Jamb	Head & Sill		Jamb	Head & Sill		Jamb	Head & Sill		Jamb	Head & Sill		Jamb	Head & Sill		Jamb	Head & Sill		Jamb	Head & Sill		Jamb					
Reinf. Level R2			Anchor Group A																Anchor Group C																
Window Buck Width	25-1/2"	12.147	Not Allowed																1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	
	28"	13.397																	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	
	36"	17.397																	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	
	42"	20.397																	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	
	48"	23.397																	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	
	60"	29.397																	2+C2+2	2	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	3	
	75"	36.897																	2+C2+2	2	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	3	
			Anchor Group B																Anchor Group D																
Window Buck Width	25-1/2"	12.147	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3							
	28"	13.397	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3									
	36"	17.397	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3									
	42"	20.397	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3									
	48"	23.397	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	2	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3	1+C2+1	3									
	60"	29.397	2+C2+2	2	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	2	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	3									
	75"	36.897	2+C2+2	2	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	2	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	3	2+C2+2	3									

SEE TABLE 7 FOR DESIGN PRESSURE



Max. Anchor O.C. Spacing for "Integral- Fin" Installation	Anchor Group E	Anchor Group F
	3.8"	4"

GUIDE TO USING ANCHOR QUANTITY TABLES

FOR OX WINDOWS (XO SIMILAR):

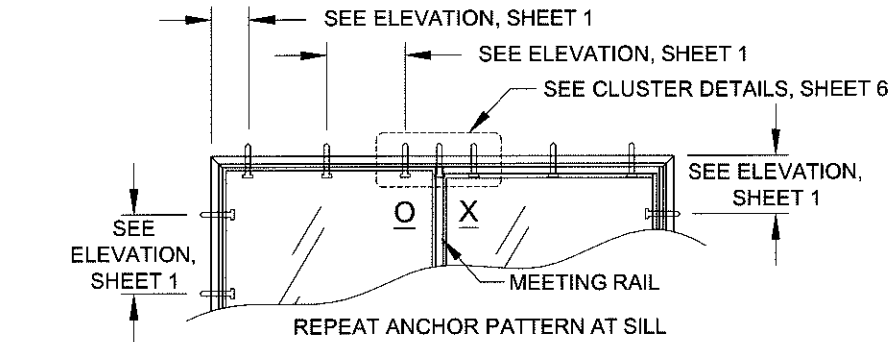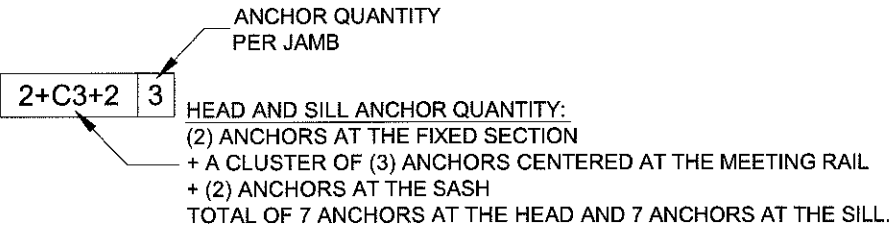

FOR XOX WINDOWS:

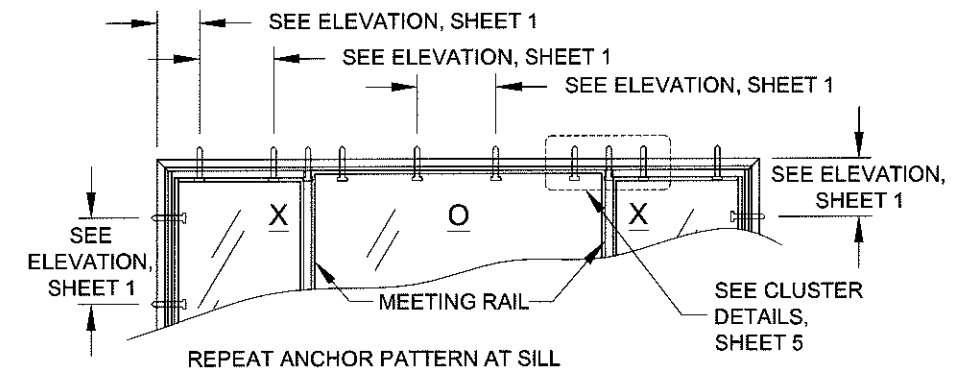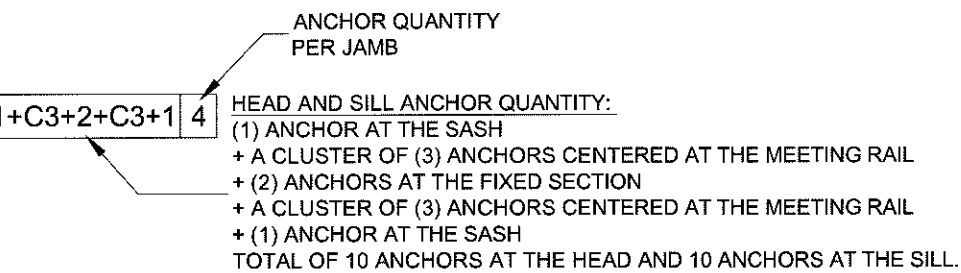

Max. Anchor O.C. Spacing for "Integral- Fin" Installation	Anchor Group F
	4"

NOTES:
1) FRAME DIMENSIONS ARE BUCK WIDTH AND BUCK HEIGHT (SEE SHEETS 3-4). SASH SIZE IS AS PER THE FIGURES ON SHEETS 6-8.
2) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE WIDTH OR HEIGHT DIMENSION SHOWN ON THE TABLE.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 16-0714-17
Expiration Date Sept. 24, 2020
By *Manuel Perez*
Miami Dade Product Control

Rev 1	
Rev 2	

1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 P.O. BOX 1529 NOKOMIS, FL 34274 (941)-480-1600	ANCHOR QUANTITY TABLES		05/15/15	J ROSOWSKI	Rev.	A
	HORIZONTAL ROLLER - LM				No.	MD-HR5510-01
	HR-5510		9 OF 18		Scale	NTS
	CERT. OF AUTH. #29286				Sheet	

6/14/16
A. LYNN MILLER, P.E.
P.E.# 58705

TABLE 19:

Glass Types 5 - 8		Sash Width (in)	Anchor Quantities for XO or OX Windows																			
			30" Height				36" Height				48" Height				54" Height				63" Height			
			Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb
Reinf. Level R3		Window Buck Width	Anchor Group A										Anchor Group C									
			1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4
	25-1/2"	12.147	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4
	28"	13.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4
	36"	17.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4
	42"	20.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4
	48"	23.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4
	60"	29.397	2+C2+2	2	2+C2+2	3	2+C2+2	4	2+C2+2	4	2+C2+2	4	2+C2+2	2	2+C2+2	3	2+C2+2	4	2+C2+2	4	2+C2+2	4
	75"	36.897	2+C2+2	2	2+C2+2	3	2+C2+2	4	2+C2+2	4	2+C3+2	4	2+C2+2	2	2+C2+2	3	2+C2+2	4	2+C2+2	4	2+C2+2	4
Reinf. Level R3		Window Buck Width	Anchor Group B										Anchor Group D									
			1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4
	25-1/2"	12.147	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4
	28"	13.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4
	36"	17.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4
	42"	20.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4
	48"	23.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	4
	60"	29.397	2+C2+2	2	2+C2+2	3	2+C2+2	4	2+C2+2	4	2+C2+2	4	2+C2+2	2	2+C2+2	3	2+C2+2	4	2+C2+2	4	2+C2+2	4
	75"	36.897	2+C2+2	2	2+C2+2	3	2+C2+2	4	2+C2+2	4	2+C2+2	4	2+C2+2	2	2+C2+2	3	2+C2+2	4	2+C2+2	4	2+C2+2	4

SEE TABLE 8 FOR DESIGN PRESSURE

Max. Anchor O.C.
Spacing for "Integral-
Fin" Installation

Anchor Group E	Anchor Group F
3.5"	4"

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 16-0714-17
Expiration Date Sept. 24, 2020
By *Manuel Sery*
Miami Dade Product Control

Rev 1	
Rev 2	


 CERT. OF AUTH. #29296				1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 P.O. BOX 1529 NOKOMIS, FL 34274 (941)-480-1600			
ANCHOR QUANTITY TABLES		Date		05/15/15			
HORIZONTAL ROLLER - LM		Drawn By		J ROSOWSKI			
HB-5510		NITS		10 OE 18		MD-HR5510-01	
Title		Desc.		Rev.		A	



TABLE 20:

Glass Types 5 - 8		Sash Width (in)	Anchor Quantities for XO or OX Windows																			
			30" Height				36" Height				48" Height				54" Height				63" Height			
			Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb
Reinf. Level R4		Window Buck Width	Anchor Group A										Anchor Group C									
			1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	5	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	5
	25-1/2"	12.147	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	5	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	5
	28"	13.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	5	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	5
	36"	17.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	5	1+C3+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C3+1	5
	42"	20.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C3+1	5	1+C3+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C3+1	5
	48"	23.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C3+1	4	1+C3+1	5	1+C3+1	2	1+C2+1	3	1+C2+1	4	1+C3+1	4	1+C3+1	5
	60"	29.397	2+C2+2	2	2+C2+2	3	2+C2+2	4	2+C3+2	4	2+C3+2	5	2+C4+2	2	2+C2+2	3	2+C2+2	4	2+C3+2	4	2+C4+2	5
	75"	36.897	2+C2+2	2	2+C2+2	3	2+C3+2	4	2+C3+2	4	2+C4+2	5	2+C4+2	2	2+C2+2	3	2+C3+2	4	2+C3+2	4	2+C4+2	5
Reinf. Level R4		Window Buck Width	Anchor Group B										Anchor Group D									
			1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	5	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	5
	25-1/2"	12.147	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	5	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	5
	28"	13.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	5	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	5
	36"	17.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	5	1+C3+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C3+1	5
	42"	20.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C3+1	5	1+C3+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C3+1	5
	48"	23.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C3+1	4	1+C3+1	5	1+C3+1	2	1+C2+1	3	1+C2+1	4	1+C3+1	4	1+C3+1	5
	60"	29.397	2+C2+2	2	2+C2+2	3	2+C2+2	4	2+C3+2	4	2+C3+2	5	2+C4+2	2	2+C2+2	3	2+C2+2	4	2+C3+2	4	2+C4+2	5
	75"	36.897	2+C2+2	2	2+C2+2	3	2+C3+2	4	2+C3+2	4	2+C4+2	5	2+C4+2	2	2+C2+2	3	2+C3+2	4	2+C3+2	4	2+C4+2	5

SEE TABLE 10 FOR DESIGN PRESSURE

Max. Anchor O.C.
Spacing for "Integral-
Fin" Installation

Anchor Group E	Anchor Group F
3.2"	4"

NOTES:
1) FRAME DIMENSIONS
ARE BUCK WIDTH AND
BUCK HEIGHT (SEE
SHEETS 3-4). SASH SIZE IS
AS PER THE FIGURES ON
SHEETS 6-8.
2) FOR SIZES NOT
SHOWN, ROUND UP TO
THE NEXT AVAILABLE
WIDTH OR HEIGHT
DIMENSION SHOWN ON
THE TABLE.
3) SEE SHEET 9 FOR A
GUIDE TO USING THESE
TABLES.

TABLE 21:

Glass Types 5 - 8		Sash Width (in)	Anchor Quantities for XO or OX Windows															
			30" Height				36" Height				48" Height				54" Height			
Reinf. Level R4			Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb
			Anchor Group A								Anchor Group C							
Window Buck Width	25-1/2"	12.147	Not Allowed								1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4
	28"	13.397									1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4
	36"	17.397									1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4
	42"	20.397									1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4
	48"	23.397									1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4
	60"	29.397									2+C2+2	2	2+C2+2	3	2+C2+2	4	2+C2+2	4
	75"	36.897									2+C2+2	2	2+C2+2	3	2+C2+2	4	2+C3+2	4
			Anchor Group B								Anchor Group D							
Window Buck Width	25-1/2"	12.147	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4
	28"	13.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4
	36"	17.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4
	42"	20.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4
	48"	23.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4
	60"	29.397	2+C2+2	2	2+C2+2	3	2+C2+2	4	2+C2+2	4	2+C3+2	2	2+C2+2	3	2+C2+2	4	2+C2+2	4
	75"	36.897	2+C2+2	2	2+C2+2	3	2+C2+2	4	2+C2+2	4	2+C3+2	2	2+C2+2	3	2+C2+2	4	2+C2+2	4

SEE TABLE 11 FOR DESIGN PRESSURE

Max. Anchor O.C.
Spacing for "Integral-
Fin" Installation

Anchor
Group F
4"

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 16-0714.17
Expiration Date Sept. 24, 2020
By *Manuel Jerez*
Miami Dade Product Control

Rev 1
Rev 2

TABLE 22:

Glass Types 10-12 & 14-16			Sash Width (in)	Anchor Quantities for XO or OX Windows																						
Reinf. Level R4		30" Height		36" Height		48" Height		54" Height		63" Height		76" Height		30" Height		36" Height		48" Height		54" Height		63" Height		76" Height		
		Head & Sill		Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb
		Anchor Group A										Anchor Group C														
Window Buck Width	25-1/2"	12.147	Not Allowed										1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	5	1+C3+1	5		
	28"	13.397											1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C3+1	5	1+C3+1	5		
	36"	17.397											1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C3+1	4	1+C3+1	5	1+C4+1	5		
	42"	20.397											1+C2+1	2	1+C2+1	3	1+C3+1	4	1+C3+1	4	1+C3+1	5	1+C4+1	5		
	48"	23.397											1+C2+1	2	1+C2+1	3	1+C3+1	4	1+C3+1	4	1+C4+1	5	1+C4+1	5		
	60"	29.397											2+C2+2	2	2+C2+2	3	2+C3+2	4	2+C3+2	4	2+C4+2	5	2+C4+2	5		
	75"	36.897											2+C2+2	2	2+C2+2	3	2+C3+2	4	2+C4+2	5	2+C4+2	5	2+C4+2	5		
			Anchor Group B										Anchor Group D													
Window Buck Width	25-1/2"	12.147	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	5	1+C3+1	5	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C2+1	5	1+C3+1	5
	28"	13.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C3+1	5	1+C3+1	5	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C2+1	4	1+C3+1	5	1+C3+1	5
	36"	17.397	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C3+1	4	1+C3+1	5	1+C4+1	5	1+C2+1	2	1+C2+1	3	1+C2+1	4	1+C3+1	4	1+C3+1	5	1+C4+1	5
	42"	20.397	1+C2+1	2	1+C2+1	3	1+C3+1	4	1+C3+1	4	1+C3+1	5	1+C4+1	5	1+C2+1	2	1+C2+1	3	1+C3+1	4	1+C3+1	4	1+C3+1	5	1+C4+1	5
	48"	23.397	1+C2+1	2	1+C2+1	3	1+C3+1	4	1+C3+1	4	1+C4+1	5	1+C4+1	5	1+C2+1	2	1+C2+1	3	1+C3+1	4	1+C3+1	4	1+C4+1	5	1+C4+1	5
	60"	29.397	2+C2+2	2	2+C2+2	3	2+C3+2	4	2+C3+2	4	2+C4+2	5	2+C4+2	5	2+C2+2	2	2+C2+2	3	2+C3+2	4	2+C3+2	4	2+C4+2	5	2+C4+2	5
	75"	36.897	2+C2+2	2	2+C2+2	3	2+C3+2	4	2+C4+2	4	2+C4+2	5	2+C4+2	5	2+C2+2	2	2+C2+2	3	2+C3+2	4	2+C4+2	4	2+C4+2	5	2+C4+2	5

SEE TABLE 12 FOR DESIGN PRESSURE

GLASS TYPES
10-12 & 14-16 MAY
NOT BE USED
WITH J-CHANNEL
OR INTEGRAL FIN
FRAMES

NOTES:
1) FRAME DIMENSIONS
ARE BUCK WIDTH AND
BUCK HEIGHT (SEE
SHEETS 3-4). SASH SIZE IS
AS PER THE FIGURES ON
SHEETS 6-8.
2) FOR SIZES NOT
SHOWN, ROUND UP TO
THE NEXT AVAILABLE
WIDTH OR HEIGHT
DIMENSION SHOWN ON
THE TABLE.
3) SEE SHEET 9 FOR A
GUIDE TO USING THESE
TABLES.

1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 P.O. BOX 1529 NOKOMIS, FL 34274 (941)-480-1600		05/15/15	J ROSOWSKI	MD-HR5510-01	A
ANCHOR QUANTITY TABLES		Date	By	DWG	Rev.
HORIZONTAL ROLLER - LM					
HR-5510 NTS					
11 OF 18					

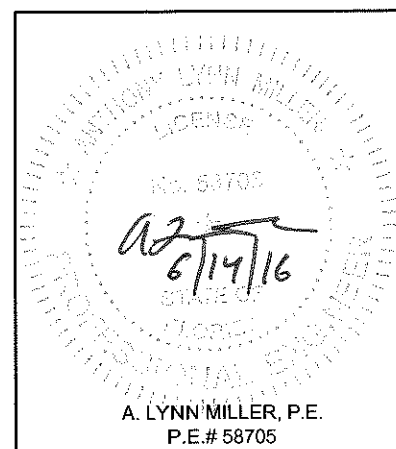


TABLE 23:

Glass Types 5 - 8		Sash Configuration	Sash Width Range (in)	Anchor Quantities for XOX Windows																							
				24" Height		30" Height		36" Height		48" Height		54" Height		63" Height		24" Height		30" Height		36" Height		48" Height		54" Height		63" Height	
				Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb
Reinf. Level R3				Anchor Group A												Anchor Group C											
Window Buck Width	35-1/4"	⅓-⅓-⅓	11.391 - 11.391	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	38"	⅓-⅓-⅓	12.308 - 12.308	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	45-1/8"	¼-½-¼	11.391 - 13.397	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
		⅓-⅓-⅓	13.398 - 14.683	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	47-3/4"	¼-½-¼	11.391 - 12.297	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
		⅓-⅓-⅓	12.298 - 15.558	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	52-1/8"	Custom	11.391 - 12.016	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
		¼-½-¼	12.017 - 13.397	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
		⅓-⅓-⅓	13.398 - 17.016	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	60"	Custom	11.391 - 13.397	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
		¼-½-¼	13.398 - 15.360	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
		⅓-⅓-⅓	15.361 - 19.641	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	75"	Custom	11.391 - 13.397	1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	4
		¼-½-¼	13.398 - 19.110	1+C2+2+C2+1	2	1+C2+2+C2+1	2	1+C2+2+C2+1	3	1+C2+2+C2+1	4	1+C2+2+C2+1	4	1+C2+2+C2+1	4	1+C2+2+C2+1	2	1+C2+2+C2+1	2	1+C2+2+C2+1	3	1+C2+2+C2+1	4	1+C2+2+C2+1	4	1+C2+2+C2+1	4
		⅓-⅓-⅓	19.111 - 24.641	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
	96"	Custom	18.360 - 19.397	1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C3+3+C3+1	4	1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	4
¼-½-¼		19.398 - 24.360	1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C3+3+C3+1	4	1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	4	
Custom		24.361 - 30.360	1+C2+2+C2+1	2	1+C2+2+C2+1	2	1+C2+2+C2+1	3	1+C2+2+C2+1	4	1+C2+2+C2+1	4	1+C3+2+C3+1	4	1+C2+2+C2+1	2	1+C2+2+C2+1	2	1+C2+2+C2+1	3	1+C2+2+C2+1	4	1+C2+2+C2+1	4	1+C2+2+C2+1	4	
120"	¼-½-¼	** - 30.360	1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C3+3+C3+1	4	1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	4	
				Anchor Group B												Anchor Group D											
Window Buck Width	35-1/4"	⅓-⅓-⅓	11.391 - 11.391	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	38"	⅓-⅓-⅓	12.308 - 12.308	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	45-1/8"	¼-½-¼	11.391 - 13.397	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
		⅓-⅓-⅓	13.398 - 14.683	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	47-3/4"	¼-½-¼	11.391 - 12.297	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
		⅓-⅓-⅓	12.298 - 15.558	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	52-1/8"	Custom	11.391 - 12.016	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
		¼-½-¼	12.017 - 13.397	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
		⅓-⅓-⅓	13.398 - 17.016	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	60"	Custom	11.391 - 13.397	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
		¼-½-¼	13.398 - 15.360	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
		⅓-⅓-⅓	15.361 - 19.641	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	75"	Custom	11.391 - 13.397	1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	4
		¼-½-¼	13.398 - 19.110	1+C2+2+C2+1	2	1+C2+2+C2+1	2	1+C2+2+C2+1	3	1+C2+2+C2+1	4	1+C2+2+C2+1	4	1+C2+2+C2+1	4	1+C2+2+C2+1	2	1+C2+2+C2+1	2	1+C2+2+C2+1	3	1+C2+2+C2+1	4	1+C2+2+C2+1	4	1+C2+2+C2+1	4
		⅓-⅓-⅓	19.111 - 24.641	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
	96"	Custom	18.360 - 19.397	1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	4
¼-½-¼		19.398 - 24.360	1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	4	
Custom		24.361 - 30.360	1+C2+2+C2+1	2	1+C2+2+C2+1	2	1+C2+2+C2+1	3	1+C2+2+C2+1	4	1+C2+2+C2+1	4	1+C2+2+C2+1	4	1+C2+2+C2+1	2	1+C2+2+C2+1	2	1+C2+2+C2+1	3	1+C2+2+C2+1	4	1+C2+2+C2+1	4	1+C2+2+C2+1	4	
120"	¼-½-¼	** - 30.360	1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	4	

Max. Anchor O.C. Spacing for "Integral- Fin" Installation	Anchor Group E	Anchor Group F
	2.9"	4"

$$^{**} \text{ MIN. SASH SIZE} = \frac{\text{WINDOW WIDTH} - 59.28}{2}$$

NOTES:

1) FRAME DIMENSIONS ARE BUCK WIDTH AND BUCK HEIGHT (SEE SHEETS 3-4).

SASH SIZE IS AS PER THE FIGURES ON SHEETS 6-8.

2) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE WIDTH OR HEIGHT DIMENSION SHOWN ON THE TABLE.


3) SEE SHEET 9 FOR A GUIDE TO USING THESE TABLES.

4) "1/4-1/2-1/4" AND "1/3-1/3-1/3" INDICATE THAT THOSE STANDARD SASH CONFIGURATIONS FALL WITHIN THE SASH WIDTH RANGE IN THE ADJACENT COLUMN. "CUSTOM" INDICATES THAT NO STANDARD SASH CONFIGURATIONS FALL WITHIN THE RANGE.

SEE TABLE 9 FOR DESIGN PRESSURE

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 16-0714.17
Expiration Date Sept. 24, 2020
By Manuel Perez
Miami/Dade Product Control

Rev 1	
Rev 2	

		1070 TECHNOLOGY DRIVE	
		N. VENICE, FL 34275	
CERT. OF AUTH. #29296		P.O. BOX 1529	
		NOKOMIS, FL 34274	
ANCHOR QUANTITY TABLES		(941)-480-1600	
		05/15/15	
Series Title		Date	
Desc.		By Drawn	
HR-5510		J ROSOWSKI	
Scale		Dwg No.	
NTS		12 OF 18	
Sheet		MD-HR5510-01	
Series		Rev.	
HR-5510		A	

6/14/16

TABLE 24:

[illegible]
$$** \text{ MIN. SASH SIZE} = \frac{\text{WINDOW WIDTH} - 59.28}{2}$$

NOTES:

1) FRAME DIMENSIONS ARE BUCK WIDTH AND BUCK HEIGHT (SEE SHEETS 3-4).

SASH SIZE IS AS PER THE FIGURES ON SHEETS 6-8.

2) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE WIDTH OR HEIGHT DIMENSION SHOWN ON THE TABLE.


3) SEE SHEET 9 FOR A GUIDE TO USING THESE TABLES.

4) "1/4-1/2-1/4" AND "1/3-1/3-1/3" INDICATE THAT THOSE STANDARD SASH CONFIGURATIONS FALL WITHIN THE SASH WIDTH RANGE IN THE ADJACENT COLUMN. "CUSTOM" INDICATES THAT NO STANDARD SASH CONFIGURATIONS FALL WITHIN THE RANGE.

SEE TABLE 13 FOR DESIGN PRESSURE

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 16-0714-17
Expiration Date Sept. 24, 2020
By Manuel Perez
Nigerian Code Product Controls

Rev 1	
Rev 2	

 CERT. OF AUTH. #29296		1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 P.O. BOX 1529 NOKOMIS, FL 34274 (941)-480-1600		05/15/15 Date	
		ANCHOR QUANTITY TABLES			
HORIZONTAL ROLLER - LM		Drawn By		J ROSOWSKI	
HR-5510	NTS	Scale	Sheet	13 OF 18	DWG No
Series Desc.		Title		MD-HR5510-01 Rev. A	

A. LYNN MILLER, P.E.
 P.E. # 58705

Glass Types 7 & 8		Sash Configuration	Sash Width Range (in)	Anchor Quantities for XOX Windows																										
Reinf. Level R4	24" Height			30" Height		36" Height		48" Height		54" Height		63" Height		24" Height		30" Height		36" Height		48" Height		54" Height		63" Height						
	Head & Sill			Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb				
Anchor Group A													Anchor Group C																	
Window Buck Width	35-1/4"	⅓-⅓-⅓	11.391 - 11.391														1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	38"	⅓-⅓-⅓	12.308 - 12.308														1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	45-1/8"	¼-½-¼	11.391 - 13.397														1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
		⅓-⅓-⅓	13.398 - 14.683														1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	47-3/4"	¼-½-¼	11.391 - 12.297														1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
		⅓-⅓-⅓	12.298 - 15.558														1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	52-1/8"	Custom	11.391 - 12.016														1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
		¼-½-¼	12.017 - 13.397														1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
		⅓-⅓-⅓	13.398 - 17.016														1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	60"	Custom	11.391 - 13.397	Not Allowed													1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
		¼-½-¼	13.398 - 15.360														1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
		⅓-⅓-⅓	15.361 - 19.641														1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	75"	Custom	11.391 - 13.397														1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	4
		¼-½-¼	13.398 - 19.110														1+C2+2+C2+1	2	1+C2+2+C2+1	2	1+C2+2+C2+1	3	1+C2+2+C2+1	4	1+C2+2+C2+1	4	1+C2+2+C2+1	4	1+C2+2+C2+1	4
		⅓-⅓-⅓	19.111 - 24.641														1+C2+1+C2+1	2	1+C2+1+C2+1	2	1+C2+1+C2+1	3	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4	1+C2+1+C2+1	4
	96"	Custom	18.360 - 19.397														1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C3+3+C3+1	4
		¼-½-¼	19.398 - 24.360														1+C2+2+C2+1	2	1+C2+2+C2+1	2	1+C2+2+C2+1	3	1+C2+2+C2+1	4	1+C2+2+C2+1	4	1+C3+2+C3+1	4	1+C3+2+C3+1	4
		Custom	24.361 - 30.360														1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C3+3+C3+1	4	1+C3+3+C3+1	4
	120"	¼-½-¼	** - 30.360														1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C2+3+C2+1	4	1+C3+3+C3+1	4	1+C3+3+C3+1	4</

Anchor Group F	3.7"
-------------------	------

2

1) FRAME DIMENSIONS ARE BUCK WIDTH AND BUCK HEIGHT (SEE SHEETS 3-4). SASH SIZE IS AS PER THE FIGURES ON SHEETS 6-8.
2) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE WIDTH OR HEIGHT DIMENSION SHOWN ON THE TABLE.
3) SEE SHEET 9 FOR A GUIDE TO USING THESE TABLES.
4) "1/4-1/2-1/4" AND "1/3-1/3-1/3" INDICATE THAT THOSE STANDARD SASH CONFIGURATIONS FALL WITHIN THE SASH WIDTH RANGE IN THE ADJACENT COLUMN. "CUSTOM" INDICATES THAT NO STANDARD SASH CONFIGURATIONS FALL WITHIN THE RANGE.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 16-0714-17
Expiration Date Sept. 24, 2020
By Manuel Perez
Miami Code Product Control

Rev 1	
Rev 2	


		1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 P.O. BOX 1529 NOKOMIS, FL 34274 (941)-480-1600		05/15/15 Date	
		CERT. OF AUTH. #29296		ANCHOR QUANTITY TABLES	
Series Desc.		HORIZONTAL ROLLER - LM		J ROSOWSKI By Drawn	
HR-5510		Scale NTS		14 OF 18	
Sheet		DWG No.		MD-HR5510-01	
Rev.		A		Rev.	

TABLE 26:

Glass Types 10 - 12			Anchor Quantities for XOX Windows																							
			24" Height		30" Height		36" Height		48" Height		54" Height		63" Height		24" Height		30" Height		36" Height		48" Height		54" Height		63" Height	
			Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb
Reinf. Level R4	Sash Configuration	Sash Width Range (in)	Anchor Group A												Anchor Group C											
Window Buck Width	35-1/4"	1/3-1/3-1/3	11.391 - 11.391												1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	38"	1/3-1/3-1/3	12.308 - 12.308												1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4
	45-1/8"	1/4-1/2-1/4	11.391 - 13.397												1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C3+0+C3+1	4
		1/3-1/3-1/3	13.398 - 14.683												1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C3+0+C3+1	4
	47-3/4"	1/4-1/2-1/4	11.391 - 12.297												1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C3+0+C3+1	4	1+C3+0+C3+1	4
		1/3-1/3-1/3	12.298 - 15.558												1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C3+0+C3+1	4	1+C3+0+C3+1	4
	52-1/8"	Custom	11.391 - 12.016												1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C3+0+C3+1	4	1+C3+0+C3+1	4	1+C3+0+C3+1	4
		1/4-1/2-1/4	12.017 - 13.397												1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C3+0+C3+1	4	1+C3+0+C3+1	4	1+C3+0+C3+1	4
	60"	1/3-1/3-1/3	13.398 - 17.016												1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C3+0+C3+1	4	1+C3+0+C3+1	4
		Custom	11.391 - 13.397												1+C2+2+C2+1	2	1+C2+2+C2+1	2	1+C2+2+C2+1	3	1+C2+2+C2+1	4	1+C3+2+C3+1	4	1+C3+2+C3+1	4
	75"	1/4-1/2-1/4	13.398 - 15.360												1+C2+1+C2+1	2	1+C2+2+C2+1	2	1+C2+2+C2+1	3	1+C2+2+C2+1	4	1+C3+2+C3+1	4	1+C3+2+C3+1	4
		1/3-1/3-1/3	15.361 - 19.641												1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C3+0+C3+1	4	1+C3+0+C3+1	4	1+C4+0+C4+1	4
Window Buck Width	96"	Custom	11.391 - 13.397												1+C2+2+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C2+3+C2+1	4	1+C3+3+C3+1	4	1+C3+3+C3+1	4
		1/4-1/2-1/4	13.398 - 19.110												1+C2+2+C2+1	2	1+C2+2+C2+1	2	1+C2+3+C2+1	3	1+C3+3+C3+1	4	1+C3+3+C3+1	4	1+C4+3+C4+1	4
	120"	1/3-1/3-1/3	19.111 - 24.641												1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C3+0+C3+1	3	1+C3+0+C3+1	4	1+C4+0+C4+1	4	1+C4+0+C4+1	4
		Custom	17.641 - 19.397												1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C3+4+C3+1	4	1+C3+4+C3+1	4	1+C4+4+C4+1	4
	140"	1/4-1/2-1/4	19.398 - 24.360												1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C3+4+C3+1	4	1+C3+4+C3+1	4	1+C4+4+C4+1	4
		1/3-1/3-1/3	24.361 - 31.641												1+C2+2+C2+1	2	2+C2+2+C2+2	2	2+C2+2+C2+2	3	2+C3+3+C3+2	4	2+C3+3+C3+2	4	2+C4+3+C4+2	4
	140"	Custom	29.641 - 32.515												2+C2+3+C2+2	2	2+C2+3+C2+2	2	2+C2+3+C2+2	3	2+C3+4+C3+2	4	2+C3+4+C3+2	4	2+C4+4+C4+2	4
		1/3-1/3-1/3	32.516 - 39.641												2+C2+2+C2+2	2	2+C2+3+C2+2	2	2+C2+3+C2+2	3	2+C3+3+C3+2	4	2+C4+3+C4+2	4	2+C4+3+C4+2	4
	140"	Custom	** - 39.641												2+C2+3+C2+2	2	2+C2+3+C2+2	2	2+C2+3+C2+2	3	2+C3+4+C3+2	4	2+C4+4+C4+2	4	2+C4+4+C4+2	4
		1/3-1/3-1/3													2+C2+3+C2+2	2	2+C2+3+C2+2	2	2+C2+3+C2+2	3	2+C3+4+C3+2	4	2+C4+4+C4+2	4	2+C4+4+C4+2	4
	140"	Custom	** - 39.641												2+C2+3+C2+2	2	2+C2+3+C2+2	2	2+C2+3+C2+2	3	2+C3+4+C3+2	4	2+C4+4+C4+2	4	2+C4+4+C4+2	4
		1/3-1/3-1/3													2+C2+3+C2+2	2	2+C2+3+C2+2	2	2+C2+3+C2+2	3	2+C3+4+C3+2	4	2+C4+4+C4+2	4	2+C4+4+C4+2	4
	140"	Custom	** - 39.641												2+C2+3+C2+2	2	2+C2+3+C2+2	2	2+C2+3+C2+2	3	2+C3+4+C3+2	4	2+C4+4+C4+2	4	2+C4+4+C4+2	4

NOTES:

1) FRAME DIMENSIONS ARE BUCK WIDTH AND BUCK HEIGHT (SEE SHEETS 3-4).

SASH SIZE IS AS PER THE FIGURES ON SHEETS 6-8.

2) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE WIDTH OR HEIGHT DIMENSION SHOWN ON THE TABLE.

3) SEE SHEET 9 FOR A GUIDE TO USING THESE TABLES.

4) "1/4-1/2-1/4" AND "1/3-1/3-1/3" INDICATE THAT THOSE STANDARD SASH CONFIGURATIONS FALL WITHIN THE SASH WIDTH RANGE IN THE ADJACENT COLUMN. "CUSTOM" INDICATES THAT NO STANDARD SASH CONFIGURATIONS FALL WITHIN THE RANGE.


SEE TABLE 15 FOR DESIGN PRESSURE

GLASS TYPES 10-12 & 14-16
MAY NOT BE USED WITH
J-CHANNEL OR INTEGRAL
FIN FRAMES


** MIN. SASH SIZE = $\frac{\text{WINDOW WIDTH} - 60.72}{2}$

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 16-0714-17
Expiration Date Sept. 24, 2017
By *Manuel J. Jara*
Miami Dade Product Control

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
P.O. BOX 1529
NOKOMIS, FL 34274
(941)-480-1600

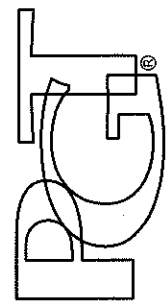

ANCHOR QUANTITY TABLES		05/15/15		J ROSOWSKI		MD-HR5510-01		A	
HORIZONTAL ROLLER - LM		Date		By		Dwg. No.		Rev.	
HR-5510		15 OF 18		Sheet		Scale		Series	

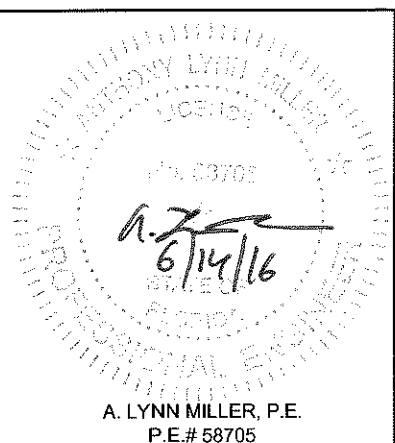

Glass Types 14 - 16				Sash Configuration				Sash Width Range (in)				Anchor Quantities for XOX Windows																													
												24" Height		30" Height		36" Height		48" Height		54" Height		63" Height		24" Height		30" Height		36" Height		48" Height		54" Height		63" Height							
												Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb	Head & Sill	Jamb				
Reinf. Level R4												Anchor Group A												Anchor Group C																	
Window Buck Width	35-1/4"	1/8-1/8-1/8	11.391 - 11.391	Not Allowed												1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	2	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C2+0+C2+1	4											
	38"	1/8-1/8-1/8	12.308 - 12.308													1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	2	3	1+C2+0+C2+1	4	1+C3+0+C3+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C2+0+C2+1	4	1+C2+0+C2+1	4	1+C3+0+C3+1	4			
	45-1/8"	1/4-1/2-1/4	11.391 - 13.397													1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	2	3	1+C3+0+C3+1	4	1+C3+0+C3+1	4	1+C4+0+C4+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C3+0+C3+1	4	1+C3+0+C3+1	4	1+C4+0+C4+1	4	
		1/8-1/8-1/8	13.398 - 14.683													1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	2	3	1+C3+0+C3+1	4	1+C3+0+C3+1	4	1+C3+0+C3+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C3+0+C3+1	4	1+C3+0+C3+1	4	1+C3+0+C3+1	4	
	47-3/4"	1/4-1/2-1/4	11.391 - 12.297													1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	2	3	1+C3+0+C3+1	4	1+C3+0+C3+1	4	1+C4+0+C4+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C3+0+C3+1	4	1+C3+0+C3+1	4	1+C4+0+C4+1	4	
		1/8-1/8-1/8	12.298 - 15.558													1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	2	3	1+C3+0+C3+1	4	1+C3+0+C3+1	4	1+C3+0+C3+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C2+0+C2+1	3	1+C3+0+C3+1	4	1+C3+0+C3+1	4	1+C4+0+C4+1	4	
	52-1/8"	Custom	11.391 - 12.016													1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C3+0+C3+1	3	1+C3+0+C3+1	4	1+C4+0+C4+1	4	1+C4+0+C4+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C3+0+C3+1	3	1+C3+0+C3+1	4	1+C4+0+C4+1	4	1+C4+0+C4+1	4	1+C4+0+C4+1	4
		1/4-1/2-1/4	12.017 - 13.397													1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C3+0+C3+1	3	1+C3+0+C3+1	4	1+C4+0+C4+1	4	1+C4+0+C4+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C3+0+C3+1	3	1+C3+0+C3+1	4	1+C4+0+C4+1	4	1+C4+0+C4+1	4	1+C4+0+C4+1	4
		1/8-1/8-1/8	13.398 - 17.016													1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C3+0+C3+1	3	1+C3+0+C3+1	4	1+C4+0+C4+1	4	1+C4+0+C4+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C3+0+C3+1	3	1+C3+0+C3+1	4	1+C4+0+C4+1	4	1+C4+0+C4+1	4	1+C4+0+C4+1	4
	60"	Custom	11.391 - 13.397													1+C2+2+C2+1	2	1+C2+2+C2+1	2	1+C2+2+C2+1	3	1+C3+2+C3+1	4	1+C3+2+C3+1	4	1+C4+2+C4+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C3+0+C3+1	3	1+C3+2+C3+1	4	1+C3+2+C3+1	4	1+C4+2+C4+1	4	1+C4+2+C4+1	4
		1/4-1/2-1/4	13.398 - 15.360													1+C2+2+C2+1	2	1+C2+2+C2+1	2	1+C2+2+C2+1	3	1+C3+2+C3+1	4	1+C3+2+C3+1	4	1+C4+2+C4+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C3+0+C3+1	3	1+C3+2+C3+1	4	1+C3+2+C3+1	4	1+C4+2+C4+1	4	1+C4+2+C4+1	4
		1/8-1/8-1/8	15.361 - 19.641													1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C3+0+C3+1	3	1+C4+0+C4+1	4	1+C4+0+C4+1	4	1+C5+0+C5+1	4	1+C2+0+C2+1	2	1+C2+0+C2+1	2	1+C3+0+C3+1	3	1+C4+0+C4+1	4	1+C4+0+C4+1	4	1+C5+0+C5+1	4	1+C5+0+C5+1	4
	75"	Custom	11.391 - 13.397													1+C2+3+C2+1	2	1+C2+3+C2+1	2	1+C2+3+C2+1	3	1+C3+3+C3+1	4	1																	

SEE TABLE 16 FOR DESIGN PRESSURE




$$** \text{ MIN. SASH SIZE} = \frac{\text{WINDOW WIDTH} - 60.72}{2}$$

TABLE 28:

Bill of Material			
#	Part #	Description	Material
1	620121	Frame Head, Sill and Jambs - J-Channel	PVC
2	620122	Frame Head, Sill and Jambs - Flange	PVC
3	620123	Frame Head, Sill and Jambs - Fin	PVC
4	620124	Frame Head, Sill and Jambs - Equal Leg	PVC
13	620172	Anti-Lift Insert / Trim Cover	PVC
14	620131	Fixed Meeting Rail	PVC
15	620158	Track Insert	6063 T6 Al
16	620129	Sash Rail (Sides, Top & Bottom)	PVC
17	620166	Monorail	6063 T6 Al
19	620156	Pull Rail Interlock	6063 T6 Al
20	620144	Pull Rail Interlock Cover	PVC
21	620150	Light Sash Reinforcement	6063 T6 Al
22	620151	Standard Sash Reinforcement	6063 T6 Al
23	620152	HD Sash Reinforcement	6063 T6 Al
24	620153	Standard Meeting Rail Reinforcement	6005 T5 Al
25	620154	HD Meeting Rail Reinforcement	6005 T5 Al
26	620155	H.D. Horiz. Roller Meeting Rail Reinforcement	6005 T5 Al
27	710X114PPA	#10 x 1-1/4" PH. PH SDS (Monorail Screw)	410 SS
28	61644	Weatherstrip, .187" x .270" Fin Pile	
29	61719	Weatherstrip, .187" x .220" Poly Pile	
30		#8 x 1" Ph. PH SDS (Interlock Mounting Screw)	410 SS
31	78X312PPA	#8 x 3-1/2" Ph. PH SMS (Fixed Meeting Rail Screw)	410 SS
32	71669SP	Meeting Rail Screw Support Plate	6063 T5 Al
33	720210	Weep Hole Cover	PVC
34	720187	Installation Screw Hole Plug	PVC
37	720197	Auto Lock	C Steel
38	720199	Sweep Lock	Cast Zinc
39	720196	Auto Lock Cover Assembly	Cast Zinc
40		#6 x 1-1/8" Ph. FH SDS (Auto and Sweep Lock Screw)	SS
41	720200	Auto and Sweep Lock Keeper	Cast Zinc
42	76X34PPA	#6 x 3/4" PH. PH SDS (Keeper Screw)	SS
43	7612FPTX	#6 x 1/2" FPH Tek (Reinforcement Screw)	SS
44		Leadstile Top Corner Key	Nylon
45		Leadstile Bottom Corner Key	Nylon
46		Lockstile Top Corner Key	Nylon
47		Lockstile Bottom Corner Key	Nylon
48	720204	Wheel	Nylon
72	620135	Lami. I.G. Bead	PVC
74		Backbedding, GE 7700 or Dow 791	Silicone
75	71684/5	Setting Block (7/8" x 2" x 1/8"), 85 +/- 5 duro.	EPDM
80	61011	Roll-formed Screen	Alum
81	61012	Extruded Screen Frame	Alum
82		Extruded Screen Spreader Bar	Alum
83	47042W	Screen Corner Key with Pull Ring	PVC
84	47041W/CKGLB	Screen Corner Key No Pull Ring	PVC
85	7CASP	Tension Spring	SS
86	61816C48	Screen Cloth	Fiberglass
87	61635/61614	.140" Screen Spline (Machine/Hand Rolled)	Vinyl

NOTES:

- 1) ITEMS # 5-12, 18, 35, 36, 49-71 & 73 ARE NOT USED AND ARE NOT PART OF THIS APPROVAL.
 2) PVC BY ROYAL WINDOW AND DOOR PROFILES, LTD., TO BE LABELED FOR AAMA EXTRUDER CODE.

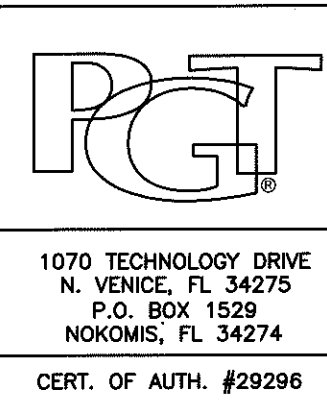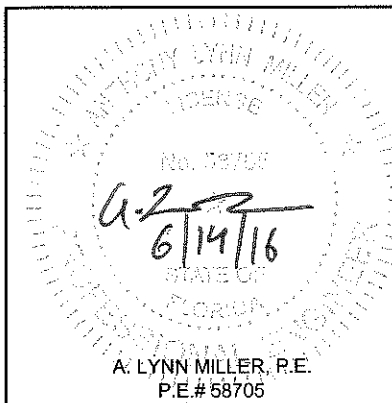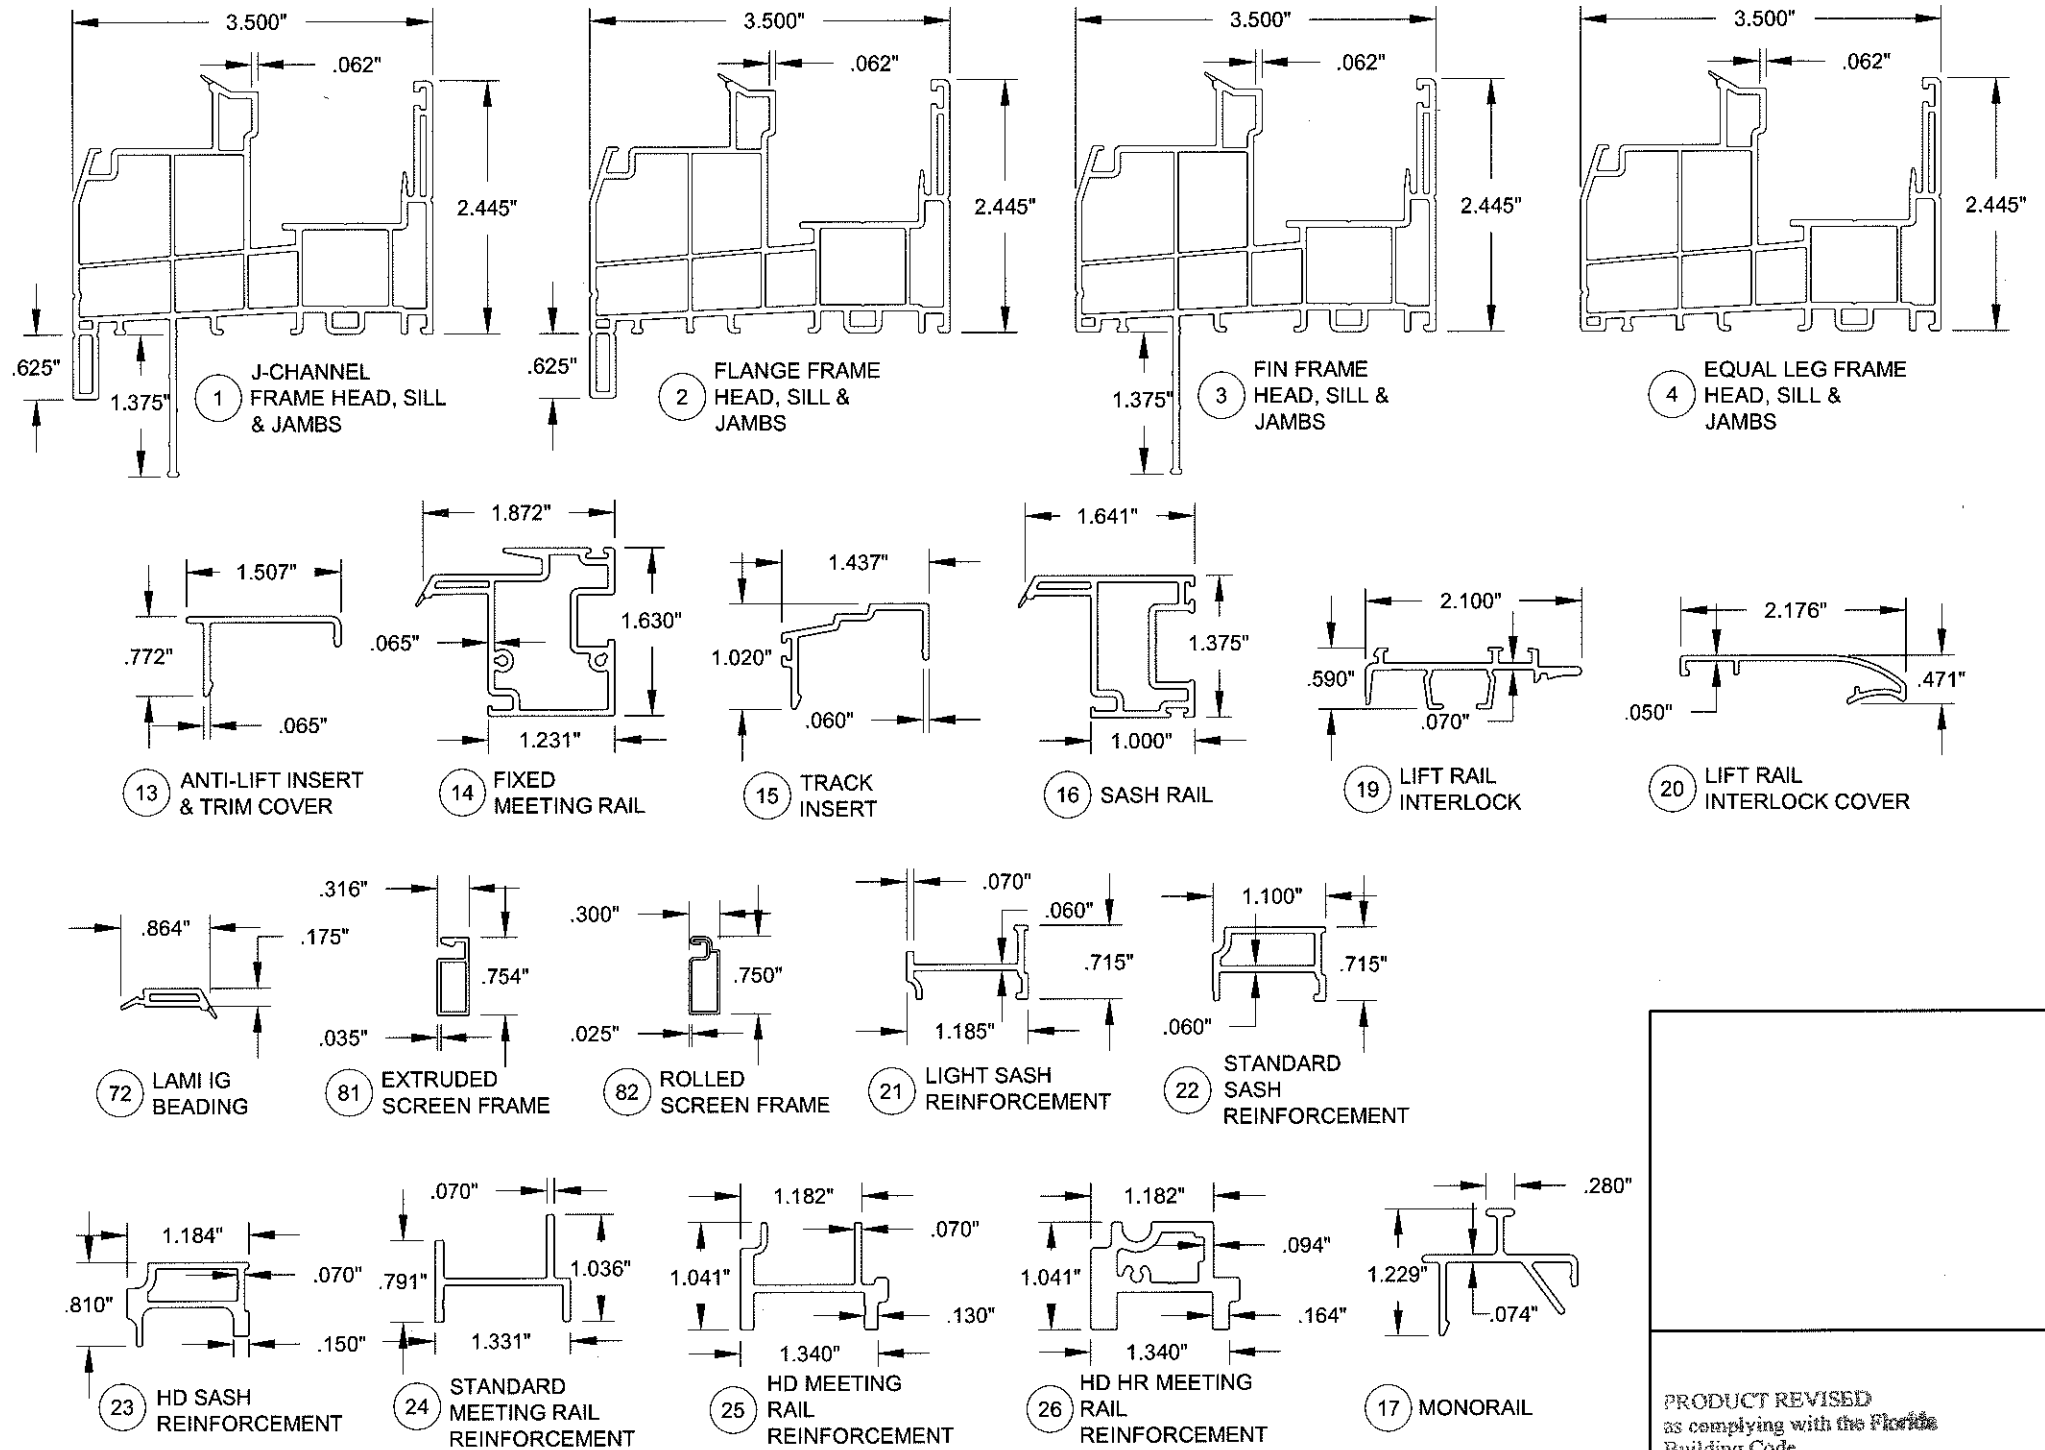

Revised By:	Date:	Revision:
Revised By:	Date:	Revision:
Description: WINDOW EXTRUSIONS & BOM		
Title: HORIZONTAL ROLLER - LM		
Series/Model: HR-5510	Scale: NTS	Sheet: 17 OF 18
Drawing No. MD-HR5510-01		Date: 05/15/15
Rev: A		

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 16-0714.17
 Expiration Date Sept. 24, 2020
 By: *Manuel Perez*
 Miami Dade Product Control

Drawn By:
 J ROSOWSKI

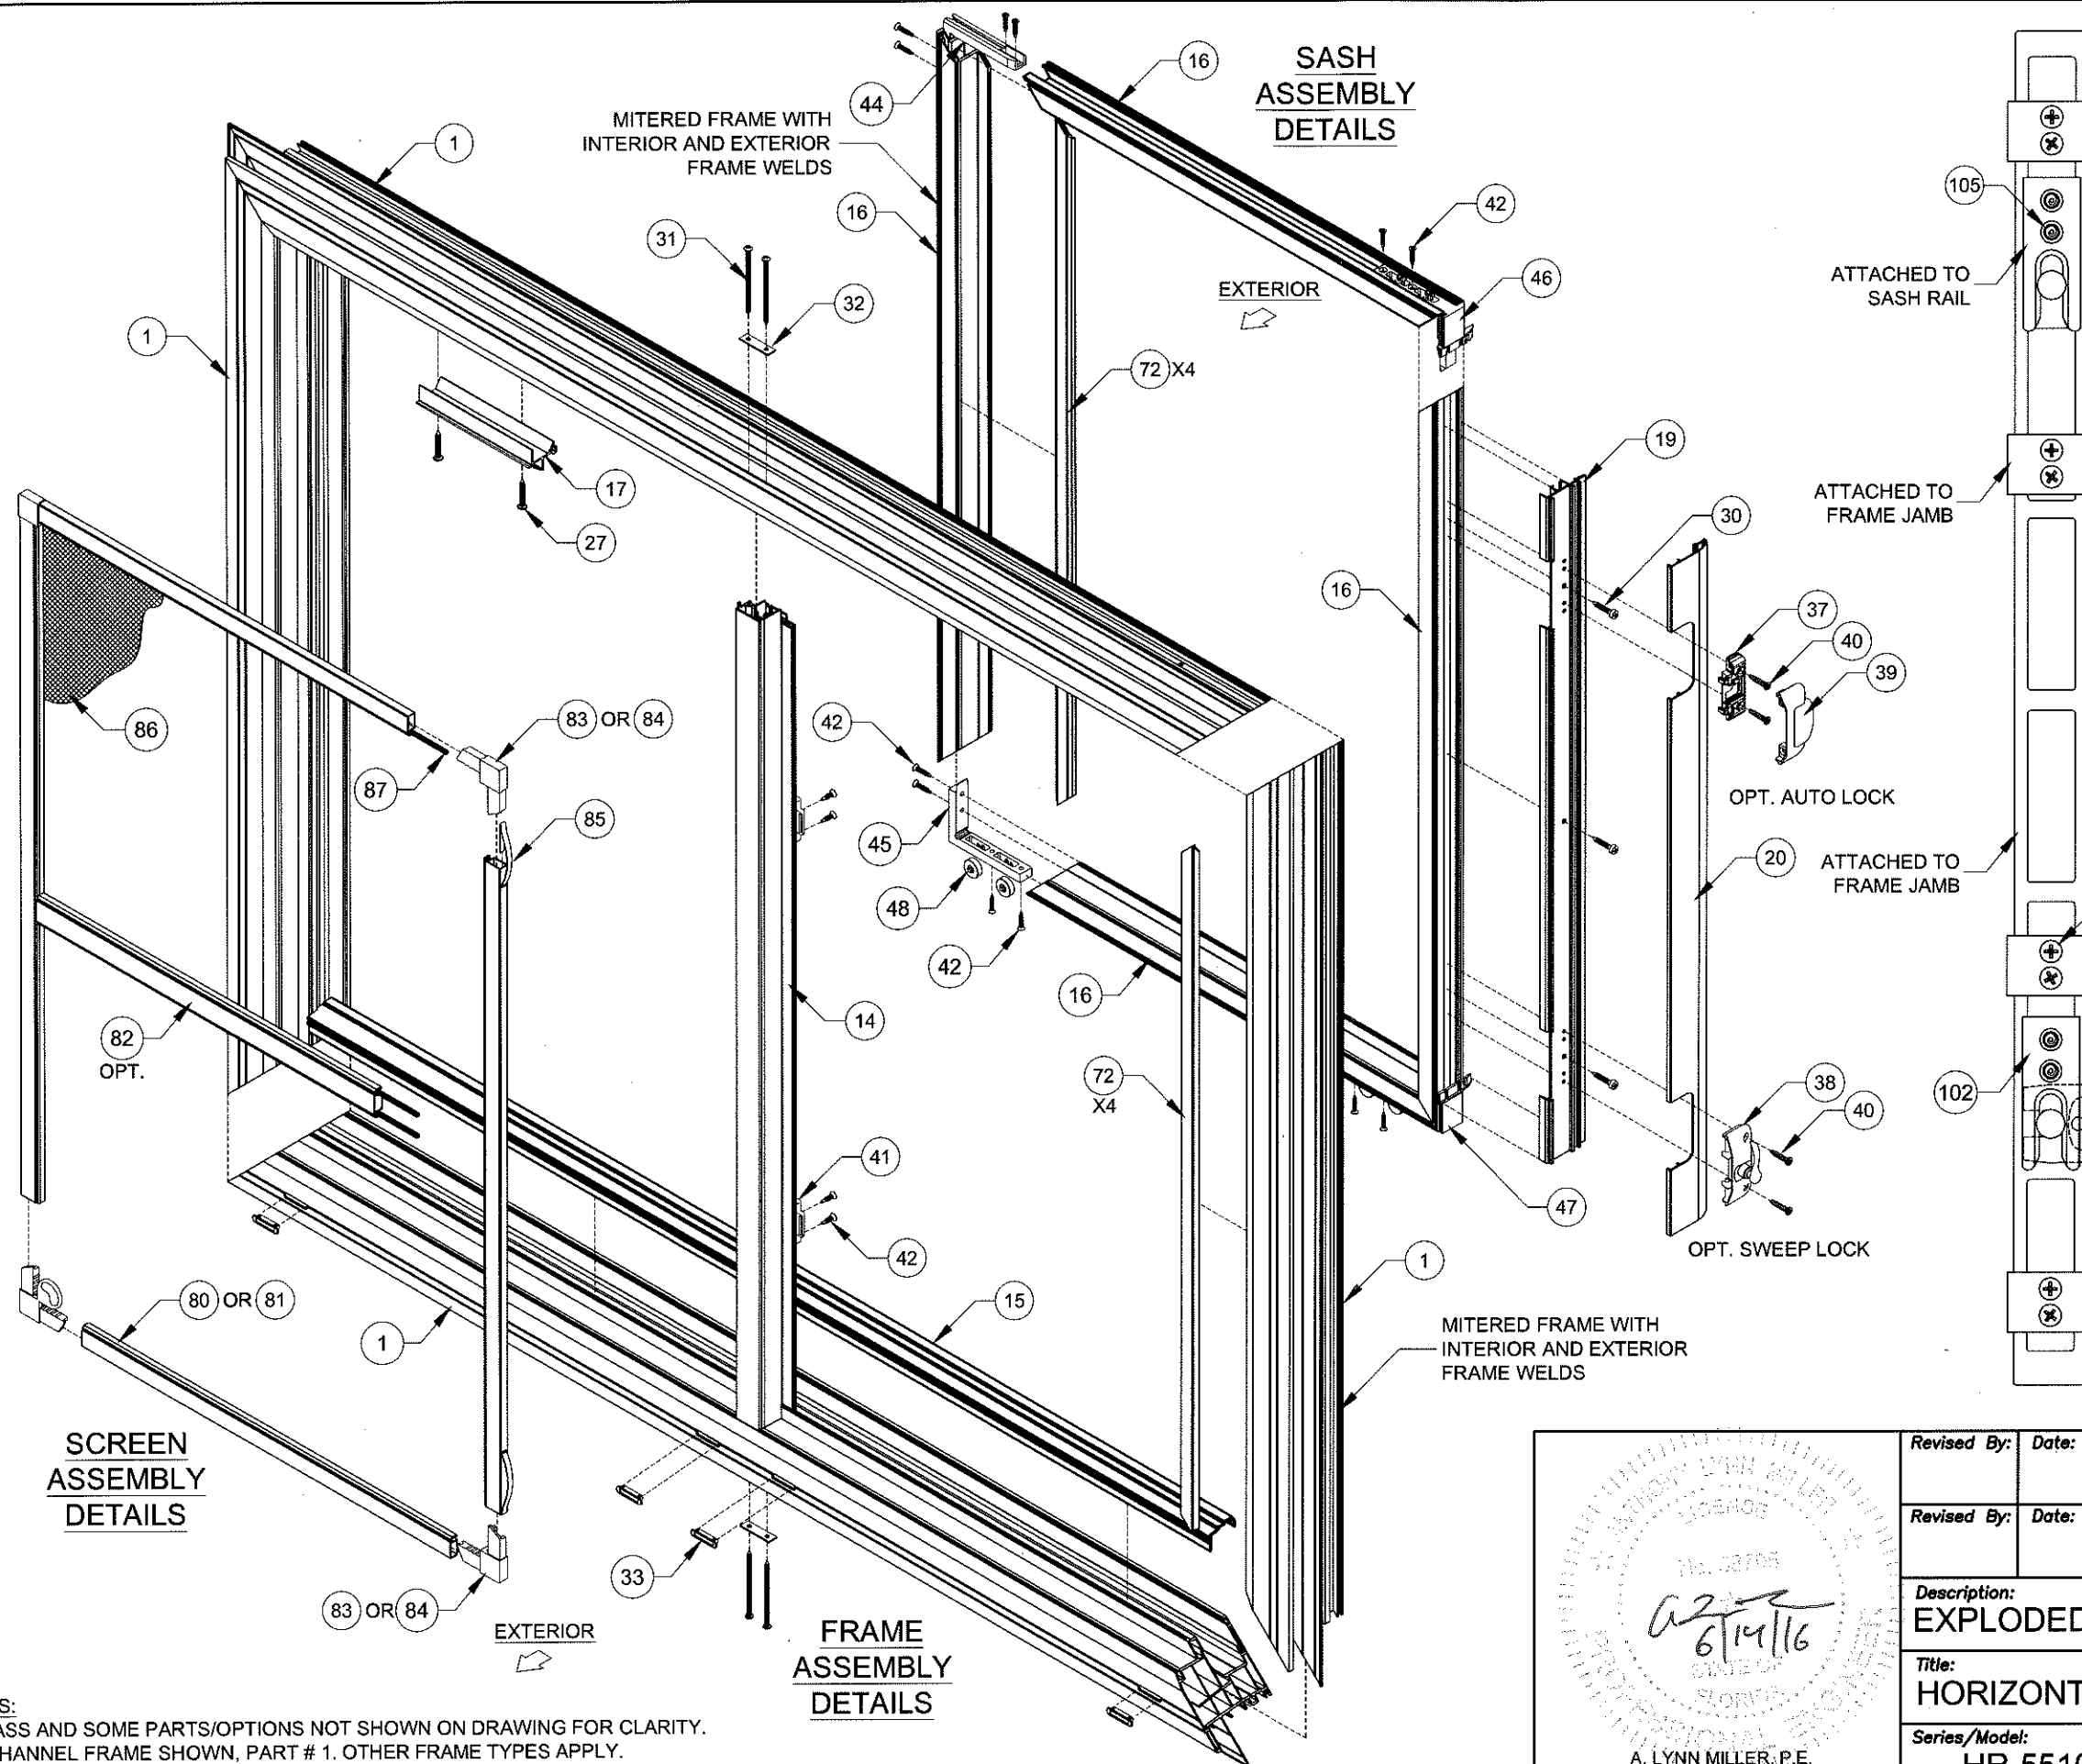


TABLE 21:

Egress Lock Bill of Material			
#	Part #	Description	Material
100	7MC7024	Multi-Point Lock Operator	Cast Zinc
101	73340	Operator mounting Plate	Steel
102	72015	Multipoint Lock Keeper	Aluminum
103	720214	Multipoint Lock Guide	Nylon
104	220217-221	Tie Bar (Length Varies)	Stainless Steel
105	71024X12HFX	#10 x 1/2" HH MS	Stainless Steel
106	78X1FPAX	#8 x 1" Ph. FH SMS	Stainless Steel
107	78X75FPTX	#8 x 3/4" Ph. FH SDS	Stainless Steel

EGRESS LOCK DETAILS
(NOT TO SCALE)


PRODUCT REVISED
as complying with the Florida
Building Code 16-0714.17
Acceptance No. 16-0714.17
Expiration Date Sept. 24, 2020
By *Manuel Perez*
Miami Dade Product Control



1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941)-480-1600

CERT. OF AUTH. #29296

- NOTES:
- 1) GLASS AND SOME PARTS/OPTIONS NOT SHOWN ON DRAWING FOR CLARITY.
 - 2) J-CCHANNEL FRAME SHOWN, PART # 1. OTHER FRAME TYPES APPLY.
 - 3) FOR REINFORCEMENT TYPES, SEE DETAILS ON SHEETS 6-8.

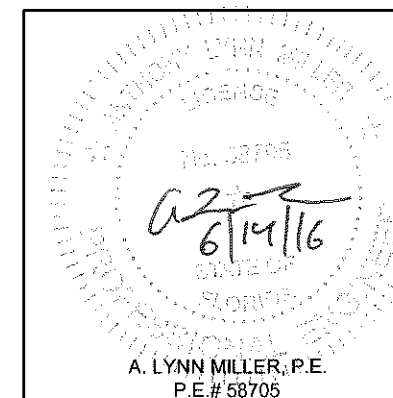

Revised By:	Date:	Revision:
Revised By:	Date:	Revision:
Description: EXPLODED WINDOW VIEW		Drawn By: J ROSOWSKI
Title: HORIZONTAL ROLLER - LM		Date: 05/15/15
Series/Model: HR-5510	Scale: NTS	Sheet: 18 OF 18
Drawing No. MD-HR5510-01		Rev: A